

1-1-1980

# An economic study of a thermal conveyance system as applied to waste heat utilization

Craig Nolan Harberts  
*Iowa State University*

Follow this and additional works at: <https://lib.dr.iastate.edu/rtd>

 Part of the [Engineering Commons](#)

## Recommended Citation

Harberts, Craig Nolan, "An economic study of a thermal conveyance system as applied to waste heat utilization" (1980). *Retrospective Theses and Dissertations*. 18296.  
<https://lib.dr.iastate.edu/rtd/18296>

This Thesis is brought to you for free and open access by the Iowa State University Capstones, Theses and Dissertations at Iowa State University Digital Repository. It has been accepted for inclusion in Retrospective Theses and Dissertations by an authorized administrator of Iowa State University Digital Repository. For more information, please contact [digirep@iastate.edu](mailto:digirep@iastate.edu).

An economic study  
of a thermal conveyance system  
as applied to waste heat utilization

by

Craig Nolan Harberts

A Thesis Submitted to the  
Graduate Faculty in Partial Fulfillment of the  
Requirements for the Degree of  
MASTER OF SCIENCE

Major: Nuclear Engineering

---

Signatures have been redacted for privacy

Iowa State University  
Ames, Iowa

1980

## TABLE OF CONTENTS

|  | Page |
|--|------|
| INTRODUCTION . . . . .   | 1    |
| Literature Review . . . . .  | 3    |
| STATEMENT OF THE PROBLEM . . . . .                                       | 6    |
| Guidelines and Utilization Costs . . . . .                               | 6    |
| OBJECTIVE . . . . .  | 9    |
| Analysis of Thermal Conveyance Systems . . . . .                         | 10   |
| System Description . . . . .   | 10   |
| Pressure Losses . . . . .  | 11   |
| Pump and Pipe Selection . . . . .  | 13   |
| Heat Losses . . . . .  | 19   |
| Installation Costs . . . . .   | 30   |
| Operating Costs . . . . .  | 35   |
| Maintenance Costs . . . . .  | 36   |
| Gross Costs . . . . .  | 38   |
| CONCLUSIONS . . . . .  | 41   |
| SUGGESTIONS FOR FUTURE WORK . . . . .                                    | 43   |
| REFERENCES . . . . .   | 44   |
| ACKNOWLEDGEMENTS . . . . .   | 47   |
| Appendix A: Pipe Specifications . . . . .                                | 48   |
| Appendix B. Pump Characteristic Curves . . . . .                         | 49   |
| Appendix C: Average Monthly Air Temperatures and<br>Velocities . . . . . | 51   |

## LIST OF TABLES

|   | Page |
|---|------|
| Table 1. Reynolds Numbers . . . . .                   | 12   |
| Table 2. Total Head Loss . . . . .                    | 14   |
| Table 3. Pump Costs . . . . .                         | 15   |
| Table 4. Pipe Costs . . . . .                         | 16   |
| Table 5. Heat Transfer Coefficients for Outside Air . | 25   |
| Table 6. Heat Loss From Uninsulated Aboveground Pipe  | 26   |
| Table 7. Heat Loss From Insulated Aboveground Pipe    | 27   |
| Table 8. Heat Loss From Buried Insulated Pipe . . . . | 28   |
| Table 9. Heat Loss From Buried Uninsulated Pipe . . . | 29   |
| Table 10. Water Temperature Drops . . . . .           | 31   |
| Table 11. Costs for the Installed PVC Pipe System . . | 31   |
| Table 12. Costs for the Installed DCI Pipe System . . | 32   |
| Table 13. Operating Costs for Pumping System . . . .  | 37   |
| Table 14. Maintenance Costs . . . . .                 | 38   |
| Table 15. PVC Gross Costs . . . . .                   | 39   |
| Table 16. DCI Gross Costs . . . . .                   | 40   |

## LIST OF FIGURES

|  | Page |
|--|------|
| Figure 1. Conveyance System . . . . .          | 10   |
| Figure 2. Pump and Pipe Costs . . . . .        | 18   |
| Figure 3. Ditch Configuration . . . . .        | 33   |
| Figure 4. Pump Characteristic Curves . . . . . | 50   |

## INTRODUCTION

Waste heat is energy that has been discharged to the environment on the assumption that it is no longer useful for the process under consideration. Generally, this waste heat is discharged in the form of condenser water with temperatures ranging from 90°F (32.2°C) to 110°F (43.3°C).

Largest and most widely distributed sources of waste heat are steam electric power plants. Energy stored in nuclear or fossil fuel is converted to electricity with efficiencies ranging from thirty to forty percent. Thus, for every three units of energy consumed only one appears as electricity and the other two are discarded as waste heat. According to Karkheck and Powell (1) today's electric generating plants produce waste heat in amounts exceeding the total U.S. space and water heat net demand. It must be noted that due to its low temperature the waste heat could not practically supply all the space and water heat demand, however, because of the vast amount available it could be utilized to provide some of the demand for energy.

District heating, based on utilizing heat currently wasted, is a potential partial solution to the problem of finding energy to meet projected U.S. demands. Heat energy required for this application is provided at temperatures higher than the normal outlet temperature of the plant's condenser water (2). Heat at this temperature is called low

grade heat, ( $100^{\circ}\text{F}$  ( $37.8^{\circ}\text{C}$ ) to  $400^{\circ}\text{F}$  ( $204.4^{\circ}\text{C}$ )), and is extracted as steam from the last stages of the turbine. Removal of this low grade heat from the turbine reduces the power plant's electrical generating capacity and hence there is a trade-off between the advantage of supplying the high temperature heat required for specific applications and the cost penalty associated with lower plant capacity. It has been shown that, through the use of multipurpose central generating stations which are a source of electricity, low grade heat, and waste heat, overall efficiencies of between 65 and 70 percent can be obtained (3).

It is unlikely that power plant thermal efficiencies of 30 to 40 percent can be improved significantly, unless higher operating temperatures are made possible through major breakthroughs in the metallurgical field. Therefore, higher energy-use efficiency in the electric power industry centers upon the application of waste heat in various integrated energy use systems.

### Literature Review

Generally speaking, energy is produced conveniently or economically at some distance from the place where it can be used. The task confronting the engineer is to transport the energy from where it is to where it is needed.

In this study the energy source is water heated to some temperature above the ambient, usually by a power plant. It must be conveyed in some manner to customers located at some distance from the source. This can be done indirectly, such as by converting the energy produced as heated water at the plant to electricity and conveying it over power lines to the customer. If necessary, the electrical energy can be turned back into heat at an appropriate temperature. The energy can also be conveyed directly by transporting the heated water through pipelines to the customer. This method of energy conveyance is studied in this investigation.

Examples of pipelines conveyance of heat can be found all over the world. In 1957, Bulgaria began using waste heat from industry and electric generating stations to heat greenhouses [4]. Nearly all Danish towns have district heating pipe networks and in Sweden considerable effort has gone into the design of heat transportation and distribution systems using waste heat from nuclear reactors [4]. Also, large district heating systems have been operated in cities like New York, Detroit, Chicago, Pittsburgh, and Rochester, New York [5].



Oak Ridge National Laboratory has studied the technical and economic feasibility of district heating in the Minneapolis-St. Paul area [6]. As of 1962, 54 U.S. cities had district heating systems [7].

Different applications require heat at different temperatures. The water or steam used in district heating is usually delivered at a temperature of 300°F. Certain chemical operations require heat at higher temperatures, whereas greenhouse heating needs can be satisfied by water heated to a temperature 10 to 20 degrees above the normal growing temperature. Due to this temperature variation, there is a difference in the piping systems used for district heating from that used for waste heat applications. A district heating transport system may cost more because of the precautions which must be taken to maintain the water at a higher temperature. This requirement might seem to imply that the transport system for district heating is more important than that for the lower temperature waste heat transport system. Actually, since the low temperature characteristics of a waste heat utilization system requires that much more water must be conveyed to deliver the required energy, the piping system will be larger and more expensive. Therefore, the piping system may contribute significantly to the cost of both district heating and waste heat utilization systems.

The cost analysis of these systems is vital. It was shown in the ORNL study that the transportation and distribu-

tion costs were 66 percent of the total investment [6].

Also, when in 1964 the Bulgarian experiment on greenhouse heating with warm water from industrial and electric generating stations was discontinued, one of the reasons given was the extensive piping requirements with associated costs [4].

Most underground heat delivery systems feature high installation and maintenance costs [8]. Ellwood Clymer, Jr. noted in this connection that "if combined heat and power usage is to become a significant part of our total energy picture, then one of the goals is to reduce main installation costs" [9].

Thus, the purpose of this research is to explore the cost composition of thermal conveyance systems as applied to waste heat utilization and to reveal how the overall costs can be reduced.

## STATEMENT OF THE PROBLEM

Once the technical practicality of a waste heat utilization project has been established, the economic aspects of the problem must be investigated. Potential hidden costs in terms of both energy and dollars are important.

### Guidelines and Utilization Costs

First of all there must be a set of basic guidelines to help define the problem and direct the way to a possible solution.

#### Guidelines

(1) No major plant modifications or design changes should result from the use of waste heat.

(2) If the operational efficiency of the power plant is reduced, the cost will be borne by the heating customers.

(3) Total cost of the waste heat delivered to the user should be competitive with alternative heat sources.

(4) The power plant operator can not be held responsible for outages, consequently the waste heat customer must provide his own standby capacity (8).

With these guidelines in mind, a practical waste heat utilization system must be economically attractive to investors.

Waste heat utilization costs can be categorized into three major groups:

- A) Energy costs
- B) Utilization costs
- C) Transportation and distribution costs

Energy Costs      The cost of the energy, in a waste heat system, will depend on the temperature that is requested by the user. In the case of waste heat being used, for example, to improve fish yields in water warmed by power plant condenser coolant(10,11), the cost could be zero as long as the power plant operation is normal with no decrease in generating capacity. Higher temperature heat would be priced to compensate the utility for the loss of revenue created by lower electrical output. This area has been explored previously(12) and will not be considered in this investigation.

Utilization Costs      Utilization costs will be made up of costs for heat exchangers, heat pumps, valves, and controls required for waste heat utilization. The cost of this equipment can be expensive because of the large volume of low temperature fluid used. This area has also been studied (6,12,13) and will not be discussed in this study.

Cost comparisons that would be initiated by the third guideline have been conducted by various people(6,12) and therefore, will not be part of this paper.

Transportation and Distribution Costs      Pumps, pipes, installation costs, and the cost of running and maintaining the system are what make up the transportation and

distribution costs. The importance of this area to the overall economic success of a waste heat utilization system must be addressed and therefore will be the main theme of this study.

## OBJECTIVE

Transportation and distribution costs are the largest fraction of the total cost of a waste heat utilization system. These costs have been shown to be as high as 66 percent of the total investment (6). Therefore, the objective of this research is to establish the most economical thermal conveyance system as applied to waste heat usage.

To accomplish this the capital costs, such as pipes and pumps, will be investigated, but more importantly the long term costs, such as operating costs, will also be studied.

Reasons for pipes and pumps being important in this water supply system is that in a waste heat environment the usable temperature difference is so low that a large volume of water must be delivered to the customer to supply the heat demand and therefore the supply system becomes large and important. Also, exploring operating costs over a long period of time is necessary in an economic study because of the effect it may have on the outcome of the study to determine which concept is the best.

If the use of waste heat is to play a role in helping to alleviate the world's energy crisis, then an economical thermal conveyance system must be developed. Then, when the associated conveyance system cost, which is a large fraction of the total, is reduced, the idea of waste heat utilization may be viable.

## ANALYSIS OF THERMAL CONVEYANCE SYSTEMS

## System Description

For this study of waste heat utilization, the type of system that will be analyzed is shown in Figure 1. Also, the system parameters held constant and those that vary are listed below. Flowrate and the coolant temperature of the plant will be held constant at 2000 gal/min and 100°F (37.7°C) respectively. The pipe diameter will change so that the trade off between high head pumps and small diameter pipes and low head pumps and large diameter pipes can be investigated.

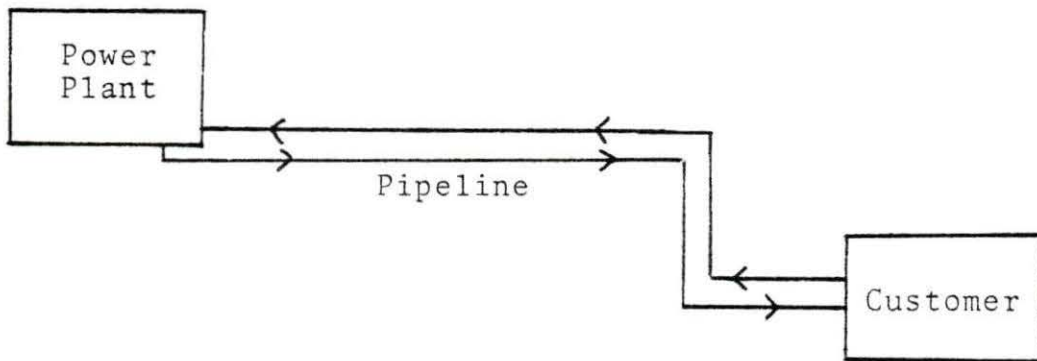


Figure 1. Conveyance System

## Systems Parameters

### A. Fixed

1. Flow in gallons/minute
2. Coolant temperature at plant

### B. Variable

1. Pipe diameter
2. Pipe material
3. Distance between power plant and customer
4. Pipe above or below ground

## Pressure Losses

In a particular application the pump chosen must provide the necessary flow through the pipe and therefore develop the required pressure head. Thus, before selecting a combination of pipe and pumps, it is necessary to calculate the pressure drop through the system. This calculation will determine the head which must be developed by the pump to distribute the water to the customers.

The pressure drop is found by using the equation (14):

$$P_f = f \frac{L}{D} \frac{\rho v^2}{2 g_c}$$

where  $P_f$  = pressure loss -  $\text{lb}_f/\text{ft}^2$   
 $f$  = friction factor - dimensionless



- L = length of pipe - feet  
 D = diameter of pipe - feet  
 $\rho$  = density of the fluid -  $\text{lb}_m/\text{ft}^3$   
 v = velocity of the fluid - ft/sec  
 $g_c$  = gravitational constant -  $32.2 \text{ lb}_m \text{ ft}/\text{lb}_f \text{ sec}^2$

The friction factor  $f$  depends on pipe inside surface characteristics and the Reynolds number, which is defined as (14):

$$\text{Re} = \frac{\rho v D}{\mu}$$

- where Re = Reynolds number - dimensionless  
 $\rho$  = density of the fluid -  $\text{lb}_m/\text{ft}^3$   
 v = velocity of the fluid - ft/sec  
 $\mu$  = viscosity of the fluid -  $\text{lb}_m/\text{ft sec}$   
 D = inside diameter of the pipe - feet

Table 1. Reynolds Numbers

| <u>Diameter</u> | <u>Velocity</u> | <u>Re #</u>        | <u>Type of Flow</u> |
|-----------------|-----------------|--------------------|---------------------|
| 8"              | 12.8 ft/sec     | $1.15 \times 10^6$ | Turbulent           |
| 10"             | 8.16 "          | $9.21 \times 10^5$ | Turbulent           |
| 12"             | 5.68 "          | $7.69 \times 10^5$ | Turbulent           |
| 14"             | 4.17 "          | $6.58 \times 10^5$ | Turbulent           |
| 16"             | 3.19 "          | $5.76 \times 10^5$ | Turbulent           |

A Reynolds number less than 2300 indicates laminar flow, whereas a Reynolds number greater than 4000 is characteristic of turbulent flow. As can be seen from Table 1, the flow is turbulent in every case.

Now that the Reynolds number is known, the friction factor can be found and the pressure losses calculated. Values in Table 2 are taken from Cameron Hydraulic Data (15) in which the results of the above calculations are tabulated. To obtain the head loss used in determining the pump size, a representative value was added to account for the head losses in bends, valves, and flow area changes in the pipe system. In the actual case this head loss may be greater than or less than the assumed value, but the pump selected will be able to handle the difference (See Appendix B). Two pipe materials were considered, polyvinyl chloride (PVC) and ductile cast iron (DCI) and the distance is the total circuit distance to and from the customer.

#### Pump and Pipe Selection

Pump selection depends on the total head loss, the corresponding flow, and the pressure range at which the pump operates most efficiently. With this information available, a suitable pump can be identified with the aid of a supplier's catalogue. For example, a 10x12x20 is a pump with a 10 inch inlet, a 12 inch outlet, and a maximum impeller size of 20 inches.

Table 2. Total Head Loss

| Distance<br>(miles) | Diameter<br>(inches) | Velocity<br>(ft/sec) | PVC Head<br>Loss (ft) | DCI Head<br>Loss (ft) |
|---------------------|----------------------|----------------------|-----------------------|-----------------------|
|                     | 8                    | 12.80                | 282                   | 285                   |
| 1/2                 | 10                   | 8.16                 | 95                    | 96                    |
|                     | 12                   | 5.68                 | 39                    | 40                    |
|                     | 14                   | 4.17                 | 18                    | 18                    |
|                     | 16                   | 3.19                 | 9                     | 9                     |
|                     | 10                   | 8.16                 | 190                   | 192                   |
| 1                   | 12                   | 5.68                 | 78                    | 79                    |
|                     | 14                   | 4.17                 | 34                    | 35                    |
|                     | 16                   | 3.19                 | 19                    | 20                    |
|                     | 10                   | 8.16                 | 381                   | 384                   |
| 2                   | 12                   | 5.68                 | 152                   | 153                   |
|                     | 14                   | 4.17                 | 71                    | 72                    |
|                     | 16                   | 3.19                 | 38                    | 39                    |

The pump for this type of application must develop a high head, be compatible with water (no corrosion), be inexpensive, and have an efficiency of at least eighty percent. The best choice is a cast iron horizontal-split case pump with bronze fittings.

Table 3 shows the cost data for different sized pumps needed for various pipe diameters and different system lengths.

Table 3. Pump Costs

| Distance<br>(miles) | Diameter<br>(inches) | Head<br>Loss<br>(ft) | Pump Size<br>(inches) | Motor<br>Size<br>(hp) | Total<br>Costs<br>(\$) |
|---------------------|----------------------|----------------------|-----------------------|-----------------------|------------------------|
| 1/2                 | 8                    | 290                  | 10x8x20               | 200                   | 13,000                 |
|                     | 10                   | 100                  | 10x8x20               | 75                    | 10,000                 |
|                     | 12                   | 41                   | 10x8x20               | 40                    | 9,000                  |
|                     | 14                   | 21                   | 12x10x12              | 20                    | 7,000                  |
| 1                   | 10                   | 200                  | 8x6x17                | 150                   | 9,000                  |
|                     | 12                   | 82                   | 8x6x14½               | 75                    | 6,000                  |
|                     | 14                   | 38                   | 10x8x12               | 25                    | 5,000                  |
|                     | 16                   | 25                   | 10x8x12               | 20                    | 5,000                  |
| 2                   | 10                   | 390                  | 10x8x20               | 300                   | 14,000                 |
|                     | 12                   | 155                  | 10x8x17               | 125                   | 10,000                 |
|                     | 14                   | 74                   | 10x8x17               | 50                    | 8,000                  |
|                     | 16                   | 45                   | 10x8x17               | 40                    | 8,000                  |

Selection of the most economical pipe depends on unit price and the desired corrosion resistance to both the fluid flowing inside the pipe and the environment outside. Polyvinyl chloride (PVC) and ductile cast iron pipe (DCI) were chosen for this study over steel, stainless steel and aluminum because they best fit these criteria, with the price being the determining factor. Both types of pipe are rated at pressures higher than that to be expected at the outlet of the pumps. The pipe specifications can be seen in Appendix A.

Pipe costs make up the largest part of the initial capital costs of the thermal conveyance system. Table 4 compares the prices of both PVC and DCI pipe.

The costs of various pump and pipe combinations can be seen in Figure 2. Data presented in Tables 3 and 4 are combined and plotted as a function of piping system length. For both pipe materials, identical pumps were used since the pump characteristics cover the range of required heads and flows needed for both types of pipe.

It can be seen from the graph that the smallest diameter and least expensive ductile cast iron pipe has the lowest combined cost. Therefore, the pipe is the determining factor as was noted previously. However, the inclusion of installation, maintenance, and operating costs will alter the outcome.

Table 4. Pipe Costs

| PVC              |                   |                   |                      | DCI               |                   |                      |
|------------------|-------------------|-------------------|----------------------|-------------------|-------------------|----------------------|
| Distance (miles) | Diameter (inches) | Cost/ft (dollars) | Total Cost (dollars) | Diameter (inches) | Cost/ft (dollars) | Total Cost (dollars) |
| 1/2              | 8                 | 12.32             | 36,000               | 8                 | 8.06              | 21,000               |
|                  | 10                | 21.11             | 56,000               | 10                | 10.61             | 28,000               |
|                  | 12                | 29.41             | 78,000               | 12                | 13.43             | 36,000               |
| 1                | 10                | 21.11             | 112,000              | 10                | 10.61             | 56,000               |
|                  | 12                | 29.41             | 155,000              | 12                | 13.43             | 71,000               |
|                  |                   |                   |                      | 14                | 16.29             | 86,000               |
|                  |                   |                   |                      | 16                | 19.01             | 100,000              |
| 2                | 10                | 21.11             | 223,000              | 10                | 10.61             | 112,000              |
|                  | 12                | 29.41             | 311,000              | 12                | 13.43             | 142,000              |
|                  |                   |                   |                      | 14                | 16.29             | 172,000              |
|                  |                   |                   |                      | 16                | 19.01             | 201,000              |

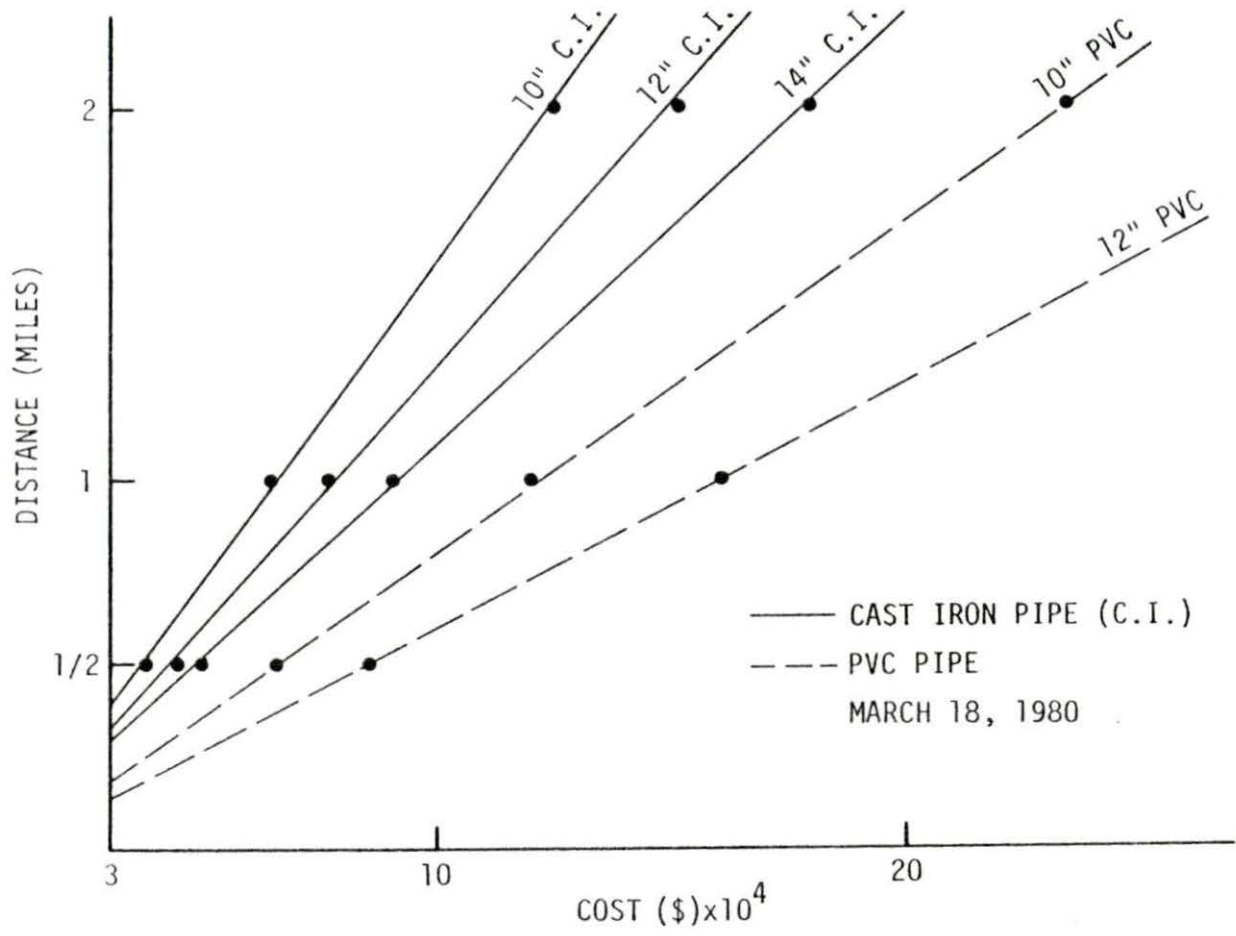


Figure 2. Pump and Pipe Costs

## Heat Losses

A thermal conveyance system's purpose is to supply water to the customer at some selected temperature. Therefore, the heat loss to the environment from the system must be considered so that the appropriate inlet temperature can be selected. To determine the best system, both in terms of cost and heat losses, different approaches were studied.

Because the water is being pumped around a circuit, the heat gained by the water from the pump must be included. The equation used to calculate the contribution is given as:

$$Q = \frac{(V)(h)}{778}$$

where  $Q$  = heat gained - BTU/hr

$V$  = volumetric flowrate -  $\text{ft}^3/\text{hr}$

$h$  = head generated -  $\text{lb}_f/\text{ft}^2$

The temperature changes in the water due to the heat gained from pumping are so small ( $\sim .3^\circ\text{F}$ ) in comparison to the initial temperature of the water ( $100^\circ\text{F}$ ) that this quantity can be neglected.

Heat losses corresponding to four different distribution systems were investigated. The systems were insulated and uninsulated aboveground systems and insulated and uninsulated buried systems. The heat transfer analysis for the aboveground cases is different from that for the buried



cases as is evident from the following equations. For the aboveground systems the heat losses are calculated using the following equation (12):

$$Q/L = \frac{T_w - T_a}{\frac{1}{\pi D h_w} + \ln \frac{(R+c)/R}{2 \pi K_p} + \frac{\ln [(R+c+d)/(R+c)]}{2 \pi K_{in}} + \frac{1}{\pi (OD) h_a}}$$

- where
- Q/L = heat loss per unit pipe length - BTU/hr ft
  - T<sub>w</sub> = temperature of water - °F
  - T<sub>a</sub> = temperature of air - °F
  - D = inside diameter of pipe - feet
  - OD = outside diameter of pipe - feet
  - h<sub>w</sub> = heat transfer coefficient of water - BTU/hr ft<sup>2</sup> °F
  - h<sub>a</sub> = heat transfer coefficient of air - BTU/hr ft<sup>2</sup> °F
  - R = inside radius of pipe - feet
  - c = thickness of pipe - feet
  - d = thickness of insulation - feet
  - K<sub>p</sub> = thermal conductivity of pipe - BTU/hr ft °F
  - K<sub>in</sub> = thermal conductivity of insulation - BTU/hr ft °F

In both underground examples, insulated and uninsulated, the heat transfer mode is heat conduction in a semi-infinite body. The equation for calculating the heat losses is (17):

Q/L =

$$\frac{T_w - T_s}{\frac{1}{\pi D h_w} + \frac{\ln \left[ \frac{(R+c)}{R} \right]}{2 \pi K_p} + \frac{\ln \left[ \frac{(R+c+d)}{(R+c)} \right]}{2 \pi K_{in}} + \frac{\ln \left[ \frac{4N}{(OD)} \right]}{2 \pi K_e}}$$

where  $T_s$  = temperature at the surface -  $^{\circ}\text{F}$   
 $N$  = depth of pipe centerline below the surface -  
 feet  
 $K_e$  = thermal conductivity of the earth -  
 BTU/hr ft  $^{\circ}\text{F}$ .

The above method used to calculate the heat losses is a simple one. It is a steady state application of conduction and convection. Values obtained for the heat loss are the maximum values that can be calculated. But, because the temperature of the fluid is so low this method approximates the heat loss very well. For a more detailed analysis the reader may refer to [18].

In the underground cases the thermal conductivity of the pipe is so large, compared to the thermal conductivity of earth ( $K_e$ ), that its effect is negligible. This makes the value of the thermal conductivity of the earth the dominant factor in the heat loss equation. Therefore, the

value for  $K_e$  was taken as  $1.0 \text{ BTU/hr ft}^{\circ}\text{F}$ . This value was used by Kendrick and Havens [18] as the steady state thermal conductivity of dry soil. Other values have been calculated [19], but this value will be used in the heat loss calculations.

In each case, a 12 inch pipe carrying  $100^{\circ}\text{F}$  water will be used as the reference case. For the insulated examples, 1 1/2 inches of urethane foam, thermal conductivity of  $.019 \text{ BTU/hr ft}^{\circ}\text{F}$ , surrounds the pipe and for the buried cases the pipe will be buried six feet deep to ensure that it lies below the frostline.

Heat loss for the aboveground pipe system involves both conduction and forced convection. Heat conduction through the pipe wall and insulation is a straightforward analysis, but the calculations of the forced convection heat transfer from the pipe to the ambient air and from the water to the pipe are more involved.

The forced convection heat transfer coefficient depends on the Reynolds number and the average Nusselt number. In the case of the aboveground system there are two heat transfer coefficients that need to be evaluated, the one between the water and the inside of the pipe,  $h_w$ , and the other between the exterior of the pipe and the outside air,  $h_a$ . For the underground analysis the only heat transfer coefficient

that is needed is  $h_w$ , and it is found in the same manner as in the aboveground case.

The connection between the forced convection heat transfer coefficient,  $h$ , is made through correlations of the form

$$\text{Nu} = K \text{Re}^n \text{Pr}^m$$

where

$$\text{Nu} = \text{Nusselt number } \frac{hD}{k}$$

$$\text{Re} = \text{Reynolds number } \frac{\rho VD}{\mu}$$

$$\text{Pr} = \text{Prandtl number } \frac{c_p \mu}{k}$$

$K$ ,  $n$  and  $m$  are well established, empirically determined constants which correspond to specific applications such as whether the flow is inside or outside the pipes; if outside whether the flow is parallel to, or perpendicular to, the pipe axis and whether the pipes are held at a constant temperature or conduct a constant heat flux.

For the case of interest in this study, with flow inside pipes and a constant wall temperature, the Dittus and Boelter correlation (12) gives  $K = 0.023$ ,  $n = 0.8$  and  $m = 1/3$ . The value of  $h_w$  was found to be  $673.0 \text{ BTU/ft}^2 \text{ hr } ^\circ\text{F}$  in all cases.

For the case of air flow over the outer surface of the pipes the correlation to be used depends on the Reynolds number. Typical speed and air temperature data (12) as presented in Appendix C were used to calculate the Reynolds

numbers shown in Table 5. The appropriate correlation for the range of Reynolds numbers is (16)

$$\text{Nu} = 0.0266 \text{ Re}^{0.805} \text{ Pr}^{1/3}$$

For the aboveground cases the Nusselt numbers and the heat transfer coefficients for the outside air are presented in Table 5. The values for the heat losses in both above-ground cases are shown in Tables 6 and 7.

Values obtained for the heat losses in both underground systems can be found in Tables 8 and 9.

Table 5. Heat Transfer Coefficients for Outside Air

| Month     | Re     | Nu    | $h_a$ |                           |
|-----------|--------|-------|-------|---------------------------|
| January   | 144887 | 339.1 | 4.14  | BTU/hr ft <sup>2</sup> °F |
| February  | 146893 | 342.8 | 4.24  | "                         |
| March     | 162129 | 271.1 | 4.60  | "                         |
| April     | 155795 | 359.0 | 4.51  | "                         |
| May       | 135518 | 320.0 | 4.05  | "                         |
| June      | 123049 | 296.8 | 3.78  | "                         |
| July      | 111692 | 274.5 | 3.51  | "                         |
| August    | 92287  | 235.4 | 3.00  | "                         |
| September | 108741 | 268.8 | 3.41  | "                         |
| October   | 122255 | 295.5 | 3.70  | "                         |
| November  | 147399 | 343.7 | 4.24  | "                         |
| December  | 150459 | 349.6 | 4.27  | "                         |
| AVERAGE   | 132886 | 316.0 | 3.95  | "                         |

Table 6. Heat Loss from Uninsulated Aboveground Pipe

| Month     | PVC            | DCI             |
|-----------|----------------|-----------------|
| January   | 2835 BTU/hr ft | 12085 BUT/hr ft |
| February  | 2409 "         | 10567 "         |
| March     | 2256 "         | 10448 "         |
| April     | 1687 "         | 7709 "          |
| May       | 1464 "         | 6225 "          |
| June      | 1084 "         | 4405 "          |
| July      | 876 "          | 3391 "          |
| August    | 955 "          | 3334 "          |
| September | 1239 "         | 4703 "          |
| October   | 1861 "         | 7453 "          |
| November  | 2482 "         | 10883 "         |
| December  | 2910 "         | 12824 "         |
| AVERAGE   | 1828 "         | 7645 "          |

Table 7. Heat Loss From Insulated Aboveground Pipe

| Month     | PVC            | DCI            |
|-----------|----------------|----------------|
| January   | 43.6 BTU/hr ft | 43.4 BTU/hr ft |
| February  | 37.3 "         | 37.2 "         |
| March     | 34.4 "         | 34.3 "         |
| April     | 25.8 "         | 25.7 "         |
| May       | 22.9 "         | 27.7 "         |
| June      | 17.2 "         | 17.1 "         |
| July      | 14.1 "         | 14.0 "         |
| August    | 15.9 "         | 15.9 "         |
| September | 20.1 "         | 20.0 "         |
| October   | 29.6 "         | 29.5 "         |
| November  | 38.4 "         | 38.3 "         |
| December  | 45.0 "         | 44.8 "         |
| AVERAGE   | 28.7 "         | 28.6 "         |



Table 8. Heat Loss From Buried Insulated Pipe

| Month     | PVC            | DCI            |
|-----------|----------------|----------------|
| January   | 35.6 BTU/hr ft | 34.3 BTU/hr ft |
| February  | 30.5 "         | 29.4 "         |
| March     | 28.2 "         | 27.1 "         |
| April     | 21.1 "         | 20.4 "         |
| May       | 18.7 "         | 18.0 "         |
| June      | 17.1 "         | 13.5 "         |
| July      | 11.5 "         | 11.1 "         |
| August    | 13.0 "         | 12.6 "         |
| September | 16.4 "         | 15.2 "         |
| October   | 24.2 "         | 23.3 "         |
| November  | 31.4 "         | 30.3 "         |
| December  | 36.8 "         | 35.5 "         |
| AVERAGE   | 23.5 "         | 22.6 "         |

Table 9. Heat Loss From Buried Uninsulated Pipe

| Month     | PVC           | DCI           |
|-----------|---------------|---------------|
| January   | 155 BTU/hr ft | 161 BTU/hr ft |
| February  | 133 "         | 138 "         |
| March     | 123 "         | 128 "         |
| April     | 92 "          | 96 "          |
| May       | 82 "          | 85 "          |
| June      | 61 "          | 64 "          |
| July      | 50 "          | 52 "          |
| August    | 57 "          | 59 "          |
| September | 72 "          | 74 "          |
| October   | 106 "         | 110 "         |
| November  | 137 "         | 142 "         |
| December  | 161 "         | 167 "         |
| AVERAGE   | 103 "         | 106 "         |

To get a better idea of what these heat losses mean, Table 10 contains data for the heat losses in terms of a water temperature drop in degrees Fahrenheit for a two mile circuit. Since December had the highest heat loss rate, the temperature drop calculations will be made for that month only. From the data in the table, the most economical installation method can be determined.

In the PVC and DCI uninsulated-aboveground-case the coolant temperature drop is  $16^{\circ}\text{F}$  and  $68^{\circ}\text{F}$  respectively. To make up this temperature loss the inlet coolant temperature would have to be raised which lowers the electrical generating efficiency and requires that a high charge be made for the waste heat. This cost, calculated over an operating period of  $1.15 \times 10^5$  hours, is more than the cost of burying the uninsulated pipe. Also, if there were any outages in the winter months, to prevent freezing the water would have to be drained from the pipes placed aboveground. Thus, the pipes must be buried below the frost line for service in the Midwest.

From the table it can be seen that the advantages of insulating pipe to be buried are negligible, consequently the appropriate technique will be to use an uninsulated buried pipe to carry the coolant from the power plant to the user.

#### Installation Costs

To install an underground piping system, a ditch must be dug, the pipe put in and assembled, and the ditch backfilled. The costs associated with these activities are based on data taken from (20) and are compared in Tables 11 and 12 for the different systems.

Table 10. Water Temperature Drops

|                         | PVC     | DCI     |
|-------------------------|---------|---------|
| Uninsulated aboveground | 15.5 °F | 68.3 °F |
| Insulated aboveground   | .24 °F  | .24 °F  |
| Insulated buried        | .20 °F  | .19 °F  |
| Uninsulated buried      | .86 °F  | .89 °F  |

Table 11. Costs for the Installed PVC Pipe System

| Distance<br>(miles) | Pipe Size<br>(inches) | Cost of Installation<br>(dollars) |
|---------------------|-----------------------|-----------------------------------|
| 1/2                 | 8                     | 23,000                            |
|                     | 10                    | 24,000                            |
|                     | 12                    | 27,000                            |
| 1                   | 10                    | 28,000                            |
|                     | 12                    | 55,000                            |
| 2                   | 10                    | 96,000                            |
|                     | 12                    | 110,000                           |

Table 12. Costs for the Installed DCI Pipe System

| Distance<br>(miles) | Pipe Size<br>(inches) | Cost of Installation<br>(dollars) |
|---------------------|-----------------------|-----------------------------------|
| 1/2                 | 8                     | 27,000                            |
|                     | 10                    | 29,000                            |
|                     | 12                    | 32,000                            |
|                     | 14                    | 41,000                            |
| 1                   | 10                    | 58,000                            |
|                     | 12                    | 65,000                            |
|                     | 14                    | 82,000                            |
|                     | 16                    | 87,000                            |
| 2                   | 10                    | 116,000                           |
|                     | 12                    | 129,000                           |
|                     | 14                    | 163,000                           |
|                     | 16                    | 175,000                           |

The type of trench to be used is shown in Figure 3. A common ditch, where both supply and return pipes are in the same hole, is utilized because of the low temperature of the water being pumped. Damp, sandy loam, typical of much of the Midwest is the soil type assumed in the calculations.

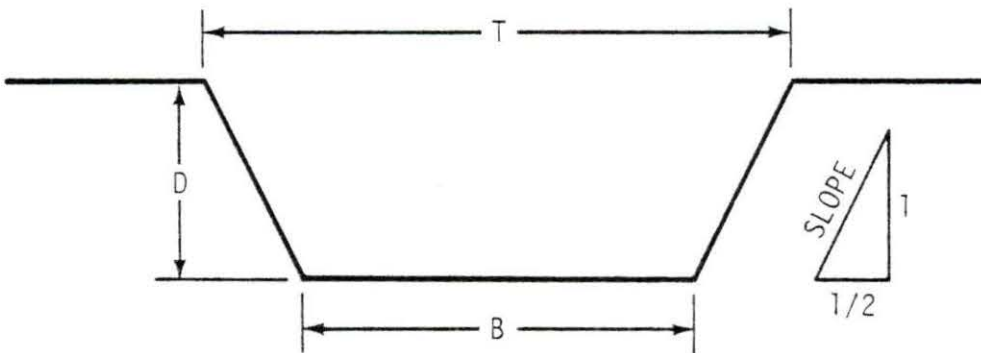


Figure 3. Ditch Configuration

By calculating the amount of earth removed, the cost of digging and backfilling the trench is obtained. The depth is six feet and the width at the bottom of the trench is found by adding both pipe diameters, a minimum of one-half foot between the side slope and the closest pipe, and a minimum of one foot between the pipes. The volume of earth to be removed per foot of trench is given as (20):

$$\text{Cubic yards/lineal foot} = \frac{1/2(B+T) \times D}{27}$$

where B = width at bottom of trench  
 T = width at top of trench  
 D = depth of trench

Electrolytic corrosion is a possible concern when burying any type of iron pipe. Cathodic protection is protection against pipe corrosion due to interactions between the pipe and soil acids. The type of ductile cast iron pipe considered in this report withstands this type of corrosion very well (21) and the suppliers recommend that no cathodic protection be provided.

### Operating Costs

The importance of operating and maintenance costs on the economic evaluation and comparison of heat transport systems cannot be overestimated. Decisions between possible systems based on equipment costs alone may prove to be wrong when actual operating and maintenance costs are introduced. Meador (22) notes that if these costs are not carefully predicted, then the choice of the pumping system reflects an acceptance of a trial and error process or, at best, an impression of past experience leading usually to an unnecessarily high overall cost.

The costs of operating the pump to transport the water around the circuit can be significant in determining which system is the most economical. Operating costs are based on the head and flow needed for the system. To calculate the number of kilowatts needed, the following equations were used (23):

$$\frac{Q \times 10 \times H}{33,000} = \text{W.H.P.}$$

$$\frac{\text{W. H. P.}}{\text{pump efficiency}} = \text{B.H.P.}$$

$$\frac{\text{B.H.P.}}{\text{motor efficiency}} = \text{E.H.P.}$$

$$\text{E.H.P} \times (.746) = \text{input kilowatts}$$



Where      Q      =      flow - gal/min  
             H      =      total head - feet  
             W.H.P. =      working horsepower  
             B.H.P. =      brake horsepower  
             E.H.P. =      electrical horsepower

The actual time during which the heat transport system would be expected to be in operation reflects the fact that during at least two summer months no heat would be required and that routine plant maintenance would involve shutdowns lasting an additional two months during the year. Thus 24 hours a day, 8 months per year and a 20 year life totals to  $1.15 \times 10^5$  hours. The associated operating costs are shown in Table 13.

#### Maintenance Costs

Maintenance costs may be estimated in various ways. The technique used in this research is to take a fixed percentage, 2.5 percent per year, of the capital investment (24). Table 14 shows the total cost for maintenance over a twenty year period for both types of systems.

Table 13. Operating Costs for Pumping System

| Distance<br>(miles) | Pipe Size<br>(inches) | Operating Costs<br>(dollars) |
|---------------------|-----------------------|------------------------------|
| 1/2                 | 8                     | 733,000                      |
|                     | 10                    | 253,000                      |
|                     | 12                    | 104,000                      |
|                     | 14                    | 53,000                       |
| 1                   | 10                    | 506,000                      |
|                     | 12                    | 207,000                      |
|                     | 14                    | 96,000                       |
|                     | 16                    | 63,000                       |
| 2                   | 10                    | 986,000                      |
|                     | 12                    | 392,000                      |
|                     | 14                    | 187,000                      |
|                     | 16                    | 114,000                      |

Table 14. Maintenance Costs

| PVC                 |                      |                                  | DCI                  |                                  |
|---------------------|----------------------|----------------------------------|----------------------|----------------------------------|
| Distance<br>(miles) | Diameter<br>(inches) | Maintenance<br>Cost<br>(dollars) | Diameter<br>(inches) | Maintenance<br>Cost<br>(dollars) |
| 1/2                 | 8                    | 34,000                           | 8                    | 31,000                           |
|                     | 10                   | 47,000                           | 10                   | 34,000                           |
|                     | 12                   | 57,000                           | 12                   | 38,000                           |
| 1                   | 10                   | 84,000                           | 14                   | 45,000                           |
|                     |                      |                                  | 10                   | 61,000                           |
|                     | 12                   | 108,000                          | 12                   | 71,000                           |
|                     |                      |                                  | 14                   | 86,000                           |
| 2                   | 10                   | 166,000                          | 16                   | 96,000                           |
|                     |                      |                                  | 10                   | 121,000                          |
|                     | 12                   | 215,000                          | 12                   | 141,000                          |
|                     |                      |                                  | 14                   | 172,000                          |
|                     |                      |                                  | 16                   | 192,000                          |

## Gross Costs

In viewing the total costs presented in Tables 15 and 16, a conclusion can be drawn about which system is the most economical. The costs of each system are shown both before and after the operating and maintenance costs were added. As was stated earlier, the operating and maintenance costs are so

large that the cost ranking of the systems established on the basis of equipment cost alone has been changed. Ductile cast iron is still favored over polyvinylchloride for the pipes but now it can be seen that large sized pipes provide the most economical system.

Table 15. PVC Gross Costs

| Distance<br>(miles) | Diameter<br>(inches) | Cost Before<br>Operating<br>Maintenance<br>(dollars) | Operating<br>and Main-<br>tenance<br>Costs<br>(dollars) | Gross Cost<br>(dollars) |
|---------------------|----------------------|--|---|-------------------------|
| 1/2                 | 8                    | 69,000   | 767,000   | 836,000                 |
|                     | 10                   | 95,000   | 300,000   | 395,000                 |
|                     | 12                   | 114,000  | 161,000   | 275,000                 |
| 1                   | 10                   | 168,000  | 590,000   | 758,000                 |
|                     | 12                   | 216,000  | 315,000   | 531,000                 |
| 2                   | 10                   | 332,000  | 1,152,000   | 1,484,000               |
|                     | 12                   | 431,000  | 607,000   | 1,038,000               |

Table 16. DCI Gross Costs

| Distance<br>(miles) | Diameter<br>(inches) | Cost Before<br>Operating &<br>Maintenance<br>(dollars) | Operating<br>and Main-<br>tenance<br>(dollars) | Gross Cost<br>(dollars) |
|---------------------|----------------------|--|--|-------------------------|
| 1/2                 | 8                    | 61,000   | 764,000  | 825,000                 |
|                     | 10                   | 67,000   | 287,000  | 354,000                 |
|                     | 12                   | 77,000   | 142,000  | 219,000                 |
|                     | 14                   | 90,000   | 98,000   | 188,000                 |
| 1                   | 10                   | 122,000  | 567,000  | 689,000                 |
|                     | 12                   | 142,000  | 278,000  | 420,000                 |
|                     | 14                   | 172,000  | 182,000  | 354,000                 |
|                     | 16                   | 192,000  | 159,000  | 351,000                 |
| 2                   | 10                   | 241,000  | 1,107,000                                      | 1,348,000               |
|                     | 12                   | 281,000  | 533,000  | 814,000                 |
|                     | 14                   | 343,000  | 359,000  | 702,000                 |
|                     | 16                   | 383,000  | 306,000  | 689,000                 |

## CONCLUSIONS

The objective of this research was to establish the most economical thermal conveyance system. By doing this the largest fraction of the total cost of a waste heat utilization system will be reduced and therefore help waste heat utilization become economically feasible.

In this study, the most economical thermal conveyance system featured ductile cast iron pipes of 14-inch diameter for a flow distance of one-half mile and 16-inch diameter for flow distances of one and two miles.

Comparing this thermal conveyance system to other studies that have been done (8,22), it can be seen that this system is less expensive. The reason is that the temperature of the water in the other studies is higher (300°F) than the temperature of the water used in the study. Also, in the Minneapolis-St. Paul study, the pipe was being installed in the city which would account for the higher cost.

Since this study is a continuation of the work of Roberts and Bahr (7), it would be sensible to compare results and determine if the idea of waste heat utilization is economical.

In the Roberts and Bahr study, it was calculated that for certain configurations that using waste heat was cheaper than using conventional fuel to heat greenhouses or raise fish. Utilizing the most economical conveyance system, it was found that the net savings gained over a 20 year period, when using

both greenhouse and aquaculture facilities, is more than twice the cost of the conveyance system.

Therefore, by looking at these results it can be said that waste heat utilization is economical and useful. But, as was stated by Daugard and Sundaram (2), the impacts of waste heat utilization should not be viewed in terms of projections based on present-day engineering, social and economic considerations, but should be viewed in terms of the basic changes in the coming years in the nature of generation and utilization of energy.

## SUGGESTIONS FOR FUTURE WORK

This research has covered a small but significant area of the work necessary in the study of waste heat utilization. Some of the work that should be done to further investigate the technical and economic feasibility of waste heat utilization is stated as follows:

(1) Study existing systems, both in the U.S. and in other countries, to obtain actual cost data on maintenance costs, pipe placement techniques, the nature of the ground in which the pipe must be laid, the effect of existing ground use, and actual savings over conventional local heating methods.

(2) Investigate the economic effects of introducing locally produced fish and vegetables into the market.

(3) Study the possibility of reduced operating costs associated with a system employing a number of small pumps in parallel, with only the pumps needed at any given time in service.

(4) Examine the regulations that may govern the transport and/or use of waste heat and the economical and technical problems associated with those regulations.



## REFERENCES

1. Karkheck, J. and J. Powell, "Prospects for the Utilization of Waste Heat in Large Scale District Heating Systems," Conference on Waste Heat Management and Utilization, Miami Beach, Florida, May 9-11, 1977.
2. Daugard, S. J. and T. R. Sundaram, "Engineering Tradeoffs Governing Waste Heat Management and Utilization," Conference on Waste Heat Management and Utilization, Miami Beach, Florida, May 9-11, 1977.
3. Steam: Its Generation and Use, Babcock & Wilcox, New York, 1978.
4. Dalrymple, D. G., A Global Review of Greenhouse Food Production, U.S. Government Printing Office, Washington, D. C., 1973.
5. Anonymous, Handbook of the National District Heating Association, The National District Heating Association, Greenville, Ohio, 1932.
6. Margen, P., L. Cronholm, K. Larssen, J. Marklund, "District Heating/Cogeneration Application Studies for the Minneapolis-St. Paul Area," Oak Ridge National Laboratory, Report No. ORNL/TM-6830, October 1979.
7. Diamant, R. M. E., J. McGarry, "Space and District Heating", London Iliffe Books Ltd., 1968.
8. Timmerman, R. W., "Utilization of Power Plant Waste Heat for Heating," Conference on Waste Heat Management and Utilization, Miami Beach, Florida, May 9-11, 1977.
9. Clymer, E. A., Jr., "A Practical Look at the Recovery of Rejected Heat by Combined Heat and Power Techniques," Conference on Waste Heat Management and Utilization, Miami Beach, Florida, May 9-11, 1977.
10. Brannon, E. L., R. E. Nakatani, and L. R. Donaldsen, "Waste Heat Employment for Accelerated Rearing of Coho Salmon," Conference on Waste Heat Management Utilization, Miami Beach, Florida, May 9-11, 1977.

11. Yu, W. C., "Thermal Aquaculture: Engineering and Economics," *Environmental Science and Technology*, 6, No. 3, 232 (1972).
12. Roberts, D. M. and D. S. Bahr, "Utilization of Waste Heat from Electric Power Generating Stations," Vol. 1, ISU-ERI-Ames-78002, Iowa State University, Ames, March 1978.
13. Reed, S. A., S. J. Hillenbrand, and M. Olszewski, "Waste Heat vs. Conventional Systems for Greenhouse Environmental Control: An Economic Assessment," Oak Ridge National Laboratory, Report No. ORNL/TM-5069.
14. Glasstone, S. and A. Sesonske, Nuclear Reactor Engineering, D. Van Nostrand Company, Inc., Princeton, New Jersey, 1963.
15. Shaw, G. V. and A. W. Loomis, Cameron Hydraulic Data, Ingersoll-Rand Company, Woodcliff Lake, N. J., 1970.
16. Karlekar, B. V. and R. M. Desmond, Engineering Heat Transfer, West Publishing Company, St. Paul, Minn., 1972.
17. Ekert, E. and R. M. Drake, Analysis of Heat and Mass Transfer, McGraw-Hill, New York, N.Y., 1972.
18. Kendrick, J. H. and J. A. Havens, *Journal of Environmental Quality*, 2, 188(1973).
19. Skaggs, R. W., D. C. Sanders, and C. R. Willey, *Transactions of the American Society of Agricultural Engineers*, 19, 159(1976).
20. Mechanical and Electrical Cost Data-1980, Robert Snow Means Company, Inc., Construction Consultants and Publishers, Kingston, Mass., 1980.
21. The Nations Pipeline, Sales Pamphlet, Griffin Pipe Products Co., Oak Brook, Ill., 1980.
22. Meador, J. T., "Thermal Conveyance Systems," Argonne National Lab Report No. ANL/CES/TE78-6, September, 1978.

23. Jenkins, J. P., Journal of New England Water Works Association, 92, 223 (1978).
24. Baker, R. J. and K. Goldsmith, "The Economic Merit of Low-Grade Heat," Energy Recovery in Process Plants, Mechanical Engineering Publications Limited for The Institution of Mechanical Engineers, New York, N.Y., 1976.

## ACKNOWLEDGEMENTS

The author would like to express his gratitude to the Affiliate Research Program in Electrical Power for the financial assistance for this research.

Consultations with Craig Wilson of Automatic Systems Inc., and LeRoy Battles, ISU Physical Plant, during the development of the conveyance system were greatly appreciated.

The author would also like to express a special appreciation to his major professor, Dr. Donald M. Roberts, for his advice and assistance during this study. His good humor and helpful comments were greatly appreciated.

## Appendix A

## Pipe Specifications

Ductile Cast Iron (21)

| <u>Inside Diameter (in)</u> | <u>Thick-ness (in)</u> | <u>Weight per foot (lbs)</u> | <u>Cost per foot (dollars)</u> | <u>Pressure Range (psi)</u> |
|-----------------------------|------------------------|------------------------------|--------------------------------|-----------------------------|
| 8                           | .27                    | 24.1                         | 8.10                           | 350                         |
| 10                          | .29                    | 31.8                         | 10.60                          | 350                         |
| 12                          | .31                    | 40.6                         | 13.40                          | 350                         |
| 14                          | .33                    | 50.6                         | 16.30                          | 350                         |
| 16                          | .34                    | 59.6                         | 19.00                          | 350                         |

Ductile Cast Iron Thermal Conductivity - 19 BTU/hr ft <sup>o</sup>F

Polyvinyl Chloride \*

| <u>Inside Diameter (in)</u> | <u>Thick-ness (in)</u> | <u>Weight per foot (lbs)</u> | <u>Cost per foot (dollars)</u> | <u>Pressure Range (psi)</u> |
|-----------------------------|------------------------|------------------------------|--------------------------------|-----------------------------|
| 8                           | .50                    | 8.2                          | 12.30                          | 250                         |
| 10                          | .59                    | 12.3                         | 21.10                          | 250                         |
| 12                          | .69                    | 17.1                         | 29.40                          | 250                         |

Polyvinyl Chloride Thermal Conductivity - .8 BTU/hr ft <sup>o</sup>F

\* PVC Pressure Pipe Sales Brochure, Robintech Corp., Industrial Ave. Grinnell, Iowa 50112

## Appendix B

## Pump Characteristic Curves

In Figure 4 the characteristics for a 10 x 8 x 12 horizontal split case pump are shown. On these curves the head losses, for the 14 and 16 inch ductile cast iron pipe, for a distance of 1 mile have been plotted. From this figure it can be seen for the 14 inch case that the pump, along with a 25 horsepower motor can supply up to 4 more feet of head than is needed. Also, for the 16 inch case this pump with a 20 horsepower motor can supply up to 12 more feet than is needed. Therefore, if there is a greater head loss than was originally calculated, the pump will be able to supply the need.

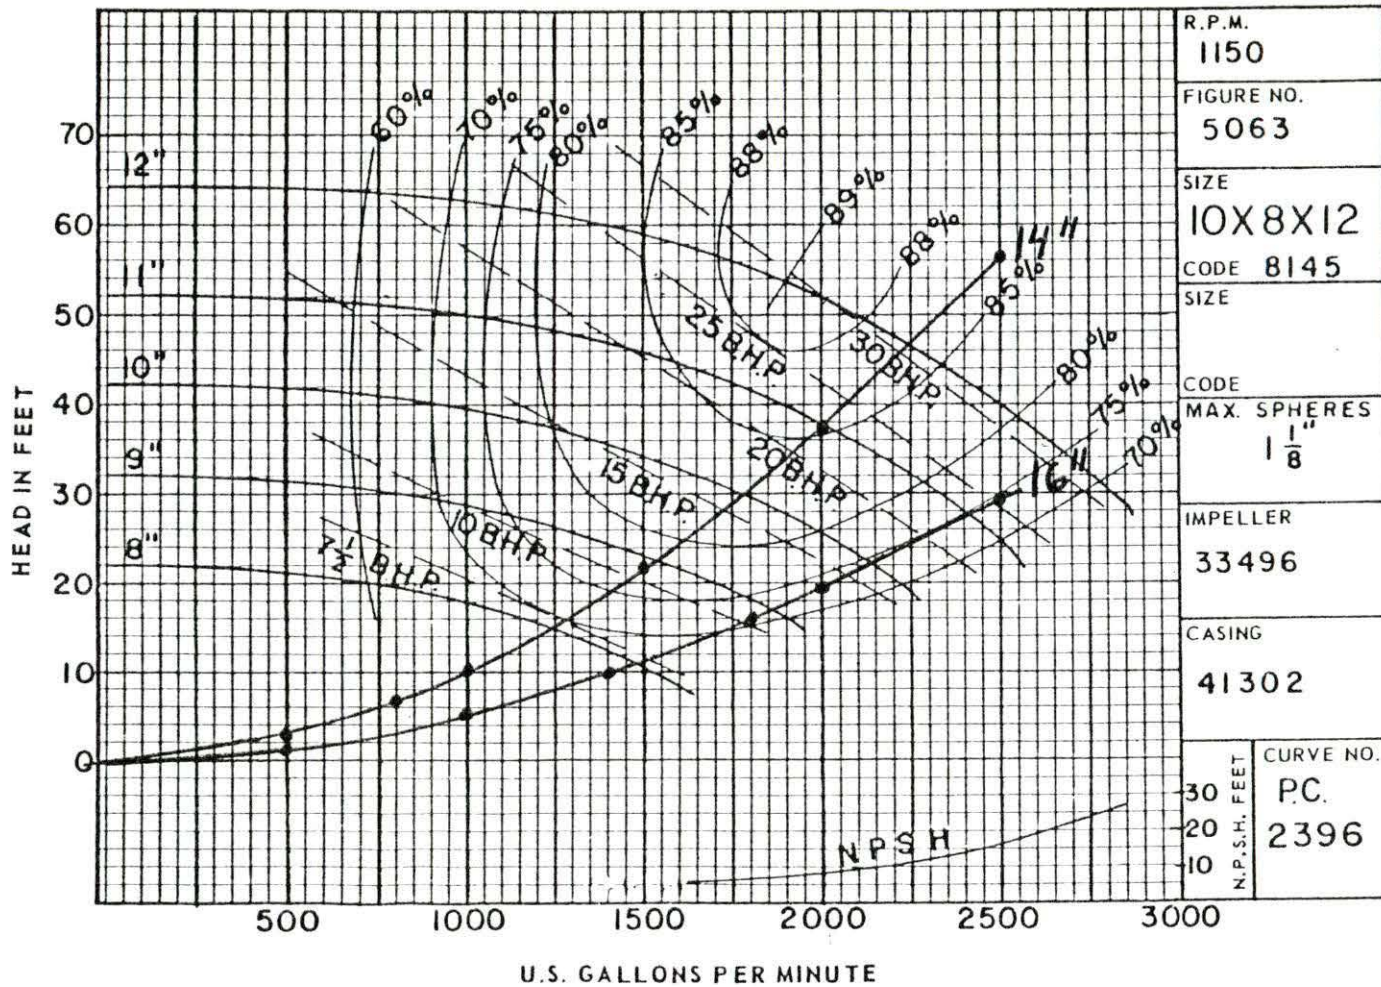


Figure 4. Pump Characteristic Curves

## Appendix C

Average Monthly Air Temperatures and Velocities [7]

| <u>Month</u> | <u>Outside Air Temperature</u> | <u>Wind Velocity</u> |
|--------------|--------------------------------|----------------------|
| January      | 21.9 °F                        | 13.0 mph             |
| February     | 33.1 °F                        | 13.5 mph             |
| March        | 38.3 °F                        | 15.0 mph             |
| April        | 53.7 °F                        | 14.9 mph             |
| May          | 59.0 °F                        | 13.0 mph             |
| June         | 69.2 °F                        | 12.0 mph             |
| July         | 74.7 °F                        | 10.8 mph             |
| August       | 71.4 °F                        | 9.0 mph              |
| September    | 64.0 °F                        | 10.2 mph             |
| October      | 46.9 °F                        | 11.5 mph             |
| November     | 31.1 °F                        | 14.6 mph             |
| December     | 19.3 °F                        | 14.5 mph             |
| AVERAGE      | 48.6 °F                        | 12.5 mph             |