

2017

# Implementing a Negative-Pressure Isolation Ward for a Surge in Airborne-Infectious Patients

Shelly L. Miller

*University of Colorado Boulder*

Nicholas Clements

*University of Colorado Boulder*

Steven A. Elliott

*VA Palo Alto Health Care System*

Shobha S. Subhash

*National Center for Occupational Health and Infection Control, Patient Care Services, Veterans Health Administration, Gainesville, Florida*

Aaron Eagan

*National Center for Occupational Health and Infection Control, Patient Care Services, Veterans Health Administration, Gainesville, Florida*

*See next page for additional authors*

Follow this and additional works at: [https://scholar.colorado.edu/mcen\\_facpapers](https://scholar.colorado.edu/mcen_facpapers)

 Part of the [Mechanical Engineering Commons](#)

## Recommended Citation

Miller, Shelly L.; Clements, Nicholas; Elliott, Steven A.; Subhash, Shobha S.; Eagan, Aaron; and Radonovich, Lewis J., "Implementing a Negative-Pressure Isolation Ward for a Surge in Airborne-Infectious Patients" (2017). *Mechanical Engineering Faculty Contributions*. 2. [https://scholar.colorado.edu/mcen\\_facpapers/2](https://scholar.colorado.edu/mcen_facpapers/2)

This Article is brought to you for free and open access by Mechanical Engineering at CU Scholar. It has been accepted for inclusion in Mechanical Engineering Faculty Contributions by an authorized administrator of CU Scholar. For more information, please contact [cuscholaradmin@colorado.edu](mailto:cuscholaradmin@colorado.edu).

---

**Authors**

Shelly L. Miller, Nicholas Clements, Steven A. Elliott, Shobha S. Subhash, Aaron Eagan, and Lewis J. Radonovich

# IMPLEMENTING A NEGATIVE-PRESSURE ISOLATION WARD FOR A SURGE IN AIRBORNE-INFECTIOUS PATIENTS

---

Shelly L. Miller<sup>1,2, \*</sup>, Nicholas Clements<sup>1,2</sup>, Steven A. Elliott<sup>3</sup>, Shobha S. Subhash<sup>2</sup>, Aaron Eagan<sup>2</sup>,  
Lewis J. Radonovich<sup>2,\*\*</sup>

<sup>1</sup>Department of Mechanical Engineering, University of Colorado, Boulder, Colorado 80309, USA

<sup>2</sup>National Center for Occupational Health and Infection Control, Patient Care Services, Veterans Health Administration, Gainesville, Florida 32601, USA

<sup>3</sup>VA Palo Alto Health Care System, Palo Alto, CA 94304, USA

\*Corresponding Author Email: [shelly.miller@colorado.edu](mailto:shelly.miller@colorado.edu)

Disclaimer: The findings and opinions expressed in the paper are the authors' own and do not necessarily represent the view of the U.S. Department of Veterans Affairs, the National Center for Occupational Health and Infection Control, VA Palo Alto Health Care System, or the University of Colorado.

\*\*Dr. Radonovich was formerly the director of the National Center for Occupational Health and Infection Control at the Veterans Health Administration.

The views expressed in this manuscript are those of the authors and do not necessarily represent the position of the U.S. Department of Veterans Affairs or its affiliates.

## ABSTRACT

Background: During a large-scale airborne infectious disease outbreak, the number of patients needing hospital-based healthcare services may exceed available negative-pressure isolation room capacity.

Methods: To test one method of increasing hospital surge capacity, a temporary negative-pressure isolation ward was established at a fully functioning hospital. Negative pressure was achieved in a 30-bed hospital ward by adjusting the ventilation system. Differential pressure was continuously measured at 22 locations, and ventilation airflow was characterized throughout the ward.

Results: The pressure on the test ward relative to the main hospital hallway was -29 Pa on average, approximately 10 times higher than the CDC guidance for airborne infection control. No occurrences of pressure reversal occurred at the entrances to the ward, even when staff entered the ward. Pressures within the ward changed, with some rooms becoming neutrally or slightly positively pressurized.

Conclusions: This study showed that establishing a temporary negative-pressure isolation ward is an effective method to increase surge capacity in a hospital.

## Highlights

- A 30-bed negative pressure isolation ward was established on a functioning hospital
- The pressure relative to the main hospital was -29 Pa by adjusting the ventilation
- No occurrences of pressure reversal occurred at ward entrance
- Pressures on the ward changed to slightly positive
- Healthcare personnel should wear personal protective equipment on the ward

1 IMPLEMENTING A NEGATIVE-PRESSURE  
2 ISOLATION WARD FOR A SURGE IN  
3 AIRBORNE-INFECTIOUS PATIENTS

---

4

## ABSTRACT

5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24

**Background:** During a large-scale airborne infectious disease outbreak, the number of patients needing hospital-based healthcare services may exceed available negative-pressure isolation room capacity.

**Methods:** To test one method of increasing hospital surge capacity, a temporary negative-pressure isolation ward was established at a fully functioning hospital. Negative pressure was achieved in a 30-bed hospital ward by adjusting the ventilation system. Differential pressure was continuously measured at 22 locations, and ventilation airflow was characterized throughout the ward.

**Results:** The pressure on the test ward relative to the main hospital hallway was -29 Pa on average, approximately 10 times higher than the CDC guidance for airborne infection control. No occurrences of pressure reversal occurred at the entrances to the ward, even when staff entered the ward. Pressures within the ward changed, with some rooms becoming neutrally or slightly positively pressurized.

**Conclusions:** This study showed that establishing a temporary negative-pressure isolation ward is an effective method to increase surge capacity in a hospital.

**Keywords:** airborne infection isolation room, respiratory infection control, pandemic preparedness, surge capacity, bioterrorism, biodefense

## BACKGROUND

25

26 Infectious disease epidemics, such as Severe Acute Respiratory Syndrome in 2003, H1N1  
27 influenza in 2009, and the outbreak of Middle Eastern Respiratory Syndrome starting in 2012,  
28 are public health threats that are best mitigated by deliberate planning at the health system  
29 level.<sup>1-3</sup> A robust response to a large-scale infectious disease outbreak is predicated, in part, on  
30 coordination between public health and healthcare delivery systems.<sup>1,4,5</sup> Hospital pandemic  
31 preparedness plans typically include protocols for handling a surge of infectious patients.<sup>6</sup>  
32 Hospitals need to respond rapidly if they are among the first-impacted by a highly contagious  
33 outbreak.<sup>7</sup>

34 The vast majority of U.S. hospitals utilize negative-pressure airborne infection isolation  
35 rooms (AIIRs) to house patients with suspected or confirmed airborne-transmissible infections.  
36 The pressure difference between an AIIR and the hospital corridor is recommended to be -2.5  
37 Pa in the U.S.<sup>8,9</sup> It is also recommended to have an air exchange rate (AER) of 12 air changes  
38 per hour (ACH), of which 2 ACH must be outside air in an AIIR.<sup>2,8</sup> In approximately one-half of  
39 urban hospitals only 2-4% of rooms are equipped with negative pressure.<sup>10</sup> The number of  
40 patients needing healthcare services may rapidly exceed such a small AIIR capacity during an  
41 airborne-transmissible pandemic or bioterror event.<sup>11</sup>

42 There are no regulations stipulating surge capacity requirements for US hospitals.  
43 Guidance for intensive care unit (ICU) capacity has been published, ranging from 20% to 300%  
44 increase in bed numbers, depending on the type of incident.<sup>5,6,11-14</sup> One option to meet capacity  
45 needs would be to implement a temporary isolation ward that could house a large number of  
46 patients. To date, there are few studies detailing the effectiveness of temporary isolation wards



47 to be used during a surge. Rosenbaum et al. demonstrated during a hospital disaster  
48 preparedness drill that multiple HEPA-filtered negative air machines placed in a physical  
49 therapy gymnasium produced the recommended pressure and AER for negative-pressure  
50 isolation.<sup>15</sup> In another demonstration, a 3-unit temporary patient shelter was constructed out  
51 of plastic sheeting and ventilated using negative-air machines.<sup>16</sup> Containment was estimated  
52 using fluorescent tracer particles, and very high levels of containment were achieved (>99%)  
53 with AERs of 15 ACH.

54 While it is recognized that increased surge capacity is an important component of  
55 hospital preparedness, more knowledge and field experience are needed to guide decisions  
56 about increasing airborne surge capacity.<sup>17</sup> The purpose of this project was to demonstrate and  
57 test whether a functional hospital wing could be operated effectively as a negative-pressure  
58 isolation ward for an entire day. Data collected included: pressure differentials at the isolation  
59 ward's outer envelope, internal variability of pressure on the ward, performance of the  
60 temporary anteroom, pressure fluctuations when ingress/egress events occurred, flow rates  
61 and AERs in bedrooms, and UV-C fluxes in stairwells.

## 62 MATERIAL AND METHODS

### 63 Isolation Ward Layout

64 A functioning hospital in the San Francisco Bay Area, Northern California, was chosen as  
65 the study site. The project was completed in March of 2015. A temporary airborne isolation  
66 ward was located where it could be effectively isolated from the rest of the hospital. A ward on  
67 the top floor of the hospital was chosen because it had a dedicated air handling unit (AHU), a

68 dedicated bathroom exhaust system, a separate dedicated exhaust system for return registers  
69 in existing isolation rooms, and a fire-wall separating the ward from the rest of the hospital.  
70 Figure 1 depicts the ward layout.

71

72 **Figure 1.** *Isolation ward layout and instrument locations.*

73

74 The ward was sealed from the rest of the hospital by closing the fire doors in one  
75 hallway (MHH, Figure 1) and by setting up a temporary anteroom in the other hallway (ANT,  
76 Figure 1). The temporary anteroom was constructed of a wood frame bolted to the ceiling.  
77 Plastic sheeting was taped to the ceiling frame, walls, and floors and fitted with two zippered-  
78 openings for doors. All doorways with access to the ward, as well as internal bedroom and  
79 bathroom doors, were kept closed during the study except for brief times during staff ingress or  
80 egress.

## 81 **Ventilation Design and Control**

82 During the demonstration, the AHU was operated with supply airflow reduced to 60% of  
83 its normal operating speed and exhaust airflow operating at capacity. The AHU was an air-to-  
84 air, constant-air-volume system, set to 100% outside air/100% exhaust manually for this study.  
85 All return and exhaust air was directly released through on-roof stacks with no mixing or  
86 recirculation. This ventilation scheme generated -29 Pa of pressure across closed fire doors in  
87 the main hospital hallway, while limiting nuisance noise on the ward produced by the AHU.

88 Two HEPA-filtered negative-air machines (MICROCON MAP800, Biological Controls)  
89 were operated at 1104 m<sup>3</sup>/hour to establish negative pressure in the temporary anteroom and

90 were exhausted into the MHH. Negative-air machine flow rates were set such that the  
91 anteroom pressure was highly negative relative to the main hospital hallway, yet not as  
92 negatively pressurized as the isolation ward, to direct air flow towards the isolation ward.

93 During planning visits, pressure measurements collected from the stairwells indicated  
94 that they were positively pressurized relative to the ward, limiting the possibility of infectious  
95 particles escaping through these spaces except when stairwell doors were opened. One  
96 solution to ensure any escaping particles are disinfected was to install upper-room germicidal  
97 ultraviolet lamps. These lamps (non-louvered GL-188, Lumalier Corp.) were installed near the  
98 door in each stairwell internal to the ward at a height of 2.1 m. UV-C fluxes were measured in  
99 both stairwells using a radiometer (Model IL1400A, International Light, Inc.) with an SEL240 UV-  
100 C sensor. UV-C measurements were collected in a grid at two distances away from each lamp  
101 with the radiometer probe facing the wall on which the lamps were hung. Prior to the  
102 demonstration, UV-C lamps were burnt-in for over 100 hours.

### 103 **Instrumentation and Data Collection**

104 Two pressure sensors (DG-700, The Energy Conservatory) were used to monitor the  
105 ward's outer negative-pressure envelope. Fifteen pressure sensors (Model T-VER-PXU-X, Veris  
106 Industries/Onset Computer Corp.) were connected to six data loggers (Model UX120-006M,  
107 Onset Computer Corp.) and monitored internal pressure variability on the ward between  
108 bedrooms, bathrooms, and the IWH. Pressure sensor probe locations, instrument names, and  
109 dataset names are included in Table 2. Reported accuracy for the DG-700 is 0.15 Pa for  
110 pressures below 1.5 Pa, and 1% of the reading at higher pressures. Three side-by-side  
111 comparisons for the two DG-700s resulted in excellent agreement. Reported accuracy for the

112 OP sensors is 0.5-1 Pa. In preliminary side-by-side comparisons, good agreement was observed  
113 between DG-700s and OP sensors.

114 A balometer (Model ABT701, TSI Inc.) was used to measure supply, return, and exhaust  
115 register flow rates. Table 2 contains the sum of all measured flow rates for the supply, return,  
116 and exhaust registers for each room. One return register in the isolation room could not be  
117 accessed, and the return register could also not be accessed in the UTL room. AERs were  
118 calculated by dividing the highest summed register flow (supply, return, or exhaust) by the  
119 room volume.

120

## 121 Data Analysis

122 Data time series were split into five time periods for analysis: pre-test (3/17/2015 17:05  
123 – 3/18/2015 13:10; 20 hours), ramp-up (3/18/2015 13:10 – 13:53; 42 minutes), negative-  
124 pressure demonstration (3/18/2015 13:53 – 3/19/2015 13:14; 23 hours), ramp-down  
125 (3/19/2015 13:14 – 13:54; 40 minutes), and post-test (3/19/2015 13:54 – 3/20/2015 9:32; 20  
126 hours). Ramp-up and ramp-down periods are not considered for data summaries because they  
127 include transition periods when the isolation ward, temporary anteroom, and UV-C lamps were  
128 being set up or taken down. The temporary anteroom and UV luminaries were operated  
129 throughout the 23-hour negative-pressure demonstration phase.

130 *Door-opening* events were separated from the *static* pressures on the ward using the  
131 average static pressure conditions. All data falling outside of boundaries along a smoothed line  
132 fit through the data were identified as door-opening events, and all data within the boundaries

133 were considered static pressure conditions. Internal pressures were typically smaller, more  
134 uncertain, and less temporally variable than outer envelope pressures.

## 135 **RESULTS**

### 136 *Air Exchange Rates, Pressures, and UV-C Flux*

137 Table 1 contains room size, sums of supply, return, and exhaust flow rates, and the  
138 estimated AER for each room during each phase of the project. BED1 and BED3 had AERs near  
139 or above the suggested AER for hospital bedrooms of 4-6 ACH.<sup>8</sup> Bedrooms lacking supply flow  
140 (BED2 and BED4) had reduced AERs.

141 **Table 1.** Volumetric Flow (m<sup>3</sup>/h) and Air Exchange Rates (1/h) Measured During the Demonstration.

		BED1	BTH1	BED2	BTH2	BED3	BTH3	BED4	ISR*	ISA	ISB	UTL**	ANT	IWH
Surface Area [m <sup>2</sup> ]		25.5	6.9	29.8	5.3	25.5	6.9	25.5	18.1	5.7	6.3	15.6	11.9	-
Volume [m <sup>3</sup> ]		69.9	16.9	81.8	13.0	69.9	16.9	69.9	49.6	15.6	15.3	47.5	32.6	-
Pre-Test	ΣSupply	505	-	0	-	395	-	0	327	121	-	154	-	4745
	ΣReturn	319	-	443	-	356	-	270	529	337	-	N/A	-	-
	ΣExhaust	-	189	-	230	-	172	-	-	-	398	-	-	-
	AER	7.2	11.1	5.4	17.7	5.6	10.1	3.9	10.7	21.6	26.0	3.2	-	-
Neg. Pressure Demo	ΣSupply	432	-	0	-	396	-	0	346	135	-	164	-	3781
	ΣReturn	343	-	482	-	386	-	325	563	347	-	N/A	-	-
	ΣExhaust	-	161	-	200	-	159	-	-	-	385	-	2209	-
	AER	6.2	9.5	5.9	15.4	5.7	9.4	4.6	11.4	22.2	25.2	3.5	67.7	-
Post-Test	ΣSupply	391	-	0	-	433	-	0	N/A	136	-	N/A	-	N/A
	ΣReturn	340	-	425	-	391	-	297	N/A	306	-	N/A	-	-
	ΣExhaust	-	170	-	195	-	170	-	-	-	382	-	-	-
	AER	5.6	10.0	5.2	15.0	6.2	10.0	4.3	N/A	19.6	25.0	N/A	-	-

142 \* Only two of three return registers were measured, so total return and air exchange rates listed here are underestimates of  
 143 actual rates. Estimating the AER for ISR using the design flow rate for the unmeasured register resulted in pre-test and  
 144 demonstration phase AERs of 15.5 and 16.1 ACH, respectively.

145 \*\* The UTL return register could not be accessed for measurements.

146

147 Means and standard deviations of static pressures are presented in Table 2. Mean

148 isolation ward pressures during the negative pressure demonstration were about -29 Pa, both

149 across the closed fire doors and the temporary anteroom. The pressure gradient across the

150 anteroom had higher-pressure differences on the ANT-MHH side than the IWH-ANT side, which

151 was the intended design.

152

**Table 2.** Static Pressure Data Measured During the Demonstration.

	Instrument Name (Hub/Channel)	Dataset Name ([-] - [+] Probe Locations)	Pre-Test Phase Mean ( $\pm$ STD, Pa)	Neg.-Pressure Demonstration Mean ( $\pm$ STD, Pa)	Post-Test Phase Mean ( $\pm$ STD, Pa)	Comments
Outer Envelope	DG-700-01 (Ch. A)	IWH-MHH <sub>1</sub>	0.0 (0.1)	-28.9 (0.9)	-	Across Fire Doors
	DG-700-02 (Ch. B)	IWH-MHH <sub>2</sub>	-	-28.8 (0.9)	-	Across Anteroom
	DG-700-01 (Ch. B)	ANT-MHH	0.0 (0.2)	-17.5 (2.4)	-	
	-	IWH-ANT	-	-11.2 (1.9)	-	Sub. Estimate
Stairwells	DG-700-02 (Ch. A)	ANT-STR1	-	-20.9 (2.6)	-	
	-	IWH-STR1	-	-32.2 (1.7)	-	Sub. Estimate
	OP-08 (OH-03)	IWH-STR2	-4.4 (1.3)	-22.2 (0.9)	-3.4 (0.9)	
Isolation Room	OP-01 (OH-01)	ISR-IWH	-19.1 (3.1)	-17.7 (0.2)	-19.5 (0.2)	
	OP-02 (OH-01)	ISR-ISA	-7.4 (1.2)	-7.1 (0.1)	-7.7 (0.1)	
	-	ISA-IWH	-11.7 (1.9)	-10.7 (0.2)	-11.8 (0.2)	Sub. Estimate
	OP-03 (OH-01)	ISB-ISR	-4.4 (0.7)	-4.1 (0.1)	-4.5 (0.1)	
Bedrooms and Bathrooms	OP-11 (OH-04)	BED1-IWH	0.0 (0.1)	0.5 (0.1)	-0.1 (0.1)	
	OP-10 (OH-04)	BTH1-BED1	-1.4 (0.2)	-1.3 (0.2)	-1.4(0.2)	
	OP-14 (OH-06)	BED2-IWH	-0.5 (1.2)	-0.6 (1.0)	-0.1 (0.1)	
	OP-15 (OH-06)	BTH2-BED2	-1.6 (1.4)	-1.7 (0.7)	-1.7(1.6)	
	OP-07 (OH-03)	BED3-IWH	-0.6 (0.1)	-0.1 (0.2)	-0.6 (0.1)	
	OP-06 (OH-03)	BTH3-BED3 <sub>1</sub>	-1.5 (0.3)	-1.4 (0.2)	-1.7 (0.2)	
	OP-09 (OH-03)	BTH3-BED3 <sub>2</sub>	-1.3 (0.3)	-1.2 (0.2)	-1.4 (0.2)	Duplicate
	OP-04 (OH-02)	BED4-IWH	-1.6 (0.6)	-1.2 (0.1)	-1.7 (0.5)	
	OP-05 (OH-02)	BTH3-BED4	-0.3 (0.3)	0.0 (0.1)	-0.3 (0.3)	
Utility Closet	OP-12 (OH-05)	UTL-IWH <sub>1</sub>	0.0 (0.1)	0.2 (0.1)	-0.1 (0.1)	
	OP-13 (OH-05)	UTL-IWH <sub>2</sub>	0.1 (0.1)	0.3(0.1)	0.1 (0.1)	Duplicate

154

155

Many internal pressures measured between bedrooms and the IWH became less

156

negative during the negative-pressure demonstration. Pressure differences across the AIIR

157

anteroom were higher on the ISA-IWH side than on the ISR-ISA side. Bedroom-IWH pressures

158

were much smaller than those measured on the ward's outer envelope.

159

In stairwell 1, the UV-C flux ranged from 10-20  $\mu\text{W}/\text{cm}^2$  at a height of 2.4 m. An

160

exponential decline in UV-C flux was observed with height in both stairwells, as expected. At a

161

height of 1.8 m the UV-C flux ranged from 0.2-0.4  $\mu\text{W}/\text{cm}^2$ . At lower heights, fluxes were less

162 impacted by the distance away from the lamp, likely because much of the light at lower heights  
163 was the result of reflection from upper-room surfaces, resulting in a homogenized spatial  
164 variability. UV-C fluxes of 20-40  $\mu\text{W}/\text{cm}^2$  are recommended for disinfecting tuberculosis.<sup>18</sup> Flux  
165 levels at lower heights were within recommended levels for human safety.<sup>19</sup>

166

### 167 Temporal Variability of Pressure Differentials

168 To explore temporal variability, smoothed pressure time series are plotted in Figures 2a  
169 and 2b. Figure 2a shows that the IWH-MHH and IWH-STR2 were relatively unchanged  
170 throughout the negative-pressure demonstration. There was also typically little temporal  
171 variability in internal pressures, with the exception of BED2. BED2 was used as a family and  
172 visitor room, and it was not possible to keep the door of this room closed throughout the  
173 demonstration.

174

175 **Figure 2.** smoothed pressure time series of (a) outer envelope and isolation room  
176 pressure differentials and (b) internal pressure differentials. Vertical lines split pre-test, ramp-  
177 up, demonstration, ramp-down, and post-test time periods.

### 178 Door-Opening Events

179 Figure 3 depicts the door-opening events compared to the steady-state pressure  
180 conditions on the ward for the outer-envelope and the ISR-IWH pressure differences. Door-  
181 opening events made up 5.7% of the outer-envelope pressure time series and 2.3% of the ISR-  
182 IWH time series. Besides the ISR-IWH pressure difference, other internal pressures did not vary



183 with door-opening events that occurred at the outer-edge of the ward's pressure envelope.  
184 Internal pressures were impacted when bedrooms and bathrooms were entered, but these  
185 were rare compared to frequent traffic by hospital staff in and out of the ward. Ward door  
186 opening events resulted in pressures typically changing to around 0 to -5 Pa. Most  
187 ingress/egress events occurred on the fire door hallway side, the side without the anteroom, as  
188 this allowed easier access. The ANT-STR1 and IWH-STR2 differences tended to only reduce to  
189 near-zero values when stairwell doors were opened, otherwise negative-pressure was  
190 maintained even when the ward was opened at other locations. The ISR-IWH pressure  
191 difference typically became more negative when the ward was depressurized, and only  
192 decreased when the AIR was entered.

193 To understand the dynamics of pressure changes during door-opening events, we  
194 calculated the length of each event, the maximum pressure reached (Figure 4), the median  
195 pressure during the event, and whether the event resulted in a positive pressure. These  
196 parameters helped identify potential deficits in ability to contain airborne infectious particles  
197 on the ward during healthcare worker (HCW) ingress or egress. Door-opening events lasted 7.5  
198 second on average, and the longest event lasted 50 seconds. Events where fire doors were not  
199 closed tightly were longer than 30 seconds. Brief pressure fluctuation events with negative  
200 median and maximum pressures are pictured as blue clusters in Figures 4c-f. For the IWH-MHH  
201 time series (Figures 4a and 4b), only one event was identified where pressures became slightly  
202 positive. No events were identified where ANT-MHH pressures became positive. Stairwells had  
203 more positive-pressure generating door-opening events. The ISR-ISA pressure difference  
204 exhibited the highest number of positive-pressure generating events.

205

206 **Figure 3.** Static pressure time series (blue markers), door opening events (red markers,  
207 grey line), trimmed-mean time series (black line), and door-opening event identification  
208 boundaries (green lines) for the outer pressure envelope during the negative-pressure  
209 demonstration.

210

211 **Figure 4.** Door-opening event maximum pressures and event lengths, with markers  
212 colored by the median pressure measured during the event.

213

## DISCUSSION

214 This project demonstrated that a temporary airborne isolation ward capable of  
215 sustained negative pressure in excess of national infection control guidelines can be designed  
216 and operated for 24 hours. In a real-life scenario, there will most likely be a need for increasing  
217 surge capacity for much longer periods. The successful maintenance of a negatively pressurized  
218 ward over long durations is achievable from an engineering standpoint following the data  
219 presented here, but there may be other clinical factors that need to be addressed for this  
220 approach to be successful in reality. More studies may be needed to show the effectiveness of  
221 such an isolation ward in maintaining surge capacity over longer periods and in terms of clinical  
222 endpoints of infection control.

223 The pressure difference between an AIIR and hospital corridor is recommended to be  
224 -2.5 Pa in the U.S., with an AER of 12 ACH, of which 2 ACH must be outside air.<sup>2,8,9</sup> Through  
225 dilution of airborne particles and limiting air migration volume, isolation rooms significantly  
226 reduce the likelihood of airborne particles escaping into adjacent corridors.<sup>20</sup> While it is clear

227 from previous studies that increased containment is observed with AIIR pressure differentials  
228 greater than -2.5 Pa,<sup>20</sup> an optimal pressure has not been determined.<sup>21</sup>

229 It was decided for this project to achieve a sizeable pressure difference on the ward  
230 while keeping nuisance noise to the staff, patients, and visitors at a minimum. We were able  
231 attain a pressure difference of -29 Pa before the noise on the ward became an issue. It was  
232 determined that this approach was warranted considering the ramifications of failing to contain  
233 an airborne disease. Using this approach, we demonstrated negative pressure could be  
234 maintained throughout the ward, even during door opening and dynamic HCW movements.

235 During the demonstration, all but one bathrooms on the ward stayed negatively  
236 pressurized relative to the adjacent bedrooms (BTH3-BED4 became neutrally pressured).  
237 Bathrooms must be kept pressurized to prevent odors and bathroom-related contamination  
238 from escaping.<sup>22</sup> Bathroom AERs were particularly high to remove odors, while bedrooms were  
239 at the recommended level of 6 ACH or lower (Table 2).<sup>8</sup>

240 A main goal of a ventilation system is to provide thermal comfort for building occupants.  
241 An additional goal in a hospital is infection control, thus many systems are 100% outside air and  
242 have higher air exchange rates than typical office buildings. When supply air is reduced, there  
243 may not be sufficient conditioned air serving the rooms and the occupants may feel more  
244 uncomfortable. This situation would be less in milder climates. This project was conducted in a  
245 milder climate, the San Francisco Bay Area where at the time of the study in March 2015, the  
246 mean temperature for the week of the study was 16 °C, with a minimum of 8 °C and a  
247 maximum of 24 °C. During the study, we received one complaint from a nurse who commented  
248 that the air felt dry.

249 The speed of the ward's AHU supply fan was reduced for the demonstration to control  
250 ventilation rates. Another option would be to control individual room dampers, which for this  
251 hospital would have added an additional layer of complexity that was beyond the scope of the  
252 demonstration. As a result, some room airflow changes within the ward were not entirely  
253 predictable. As expected, an overall reduction in supply flows was observed during the  
254 negative-pressure demonstration, but there was significant room-to-room variability. This  
255 variability resulted in two rooms within the ward (BED1 and UTL) becoming neutrally or  
256 positively pressurized during the demonstration. In BED1, the difference between the supply  
257 and return flow decreased from 186 to 89 m<sup>3</sup>/h during the pre-test and demonstration phases,  
258 respectively. Interestingly, room-to-room variability in ventilation flow changes was not limited  
259 to supply flow changes, but often return flows increased and exhaust flows decreased when  
260 negative pressure was implemented. Despite our findings that airflow reversals were rarely  
261 encountered, they are possible even when pressure gradients far exceed CDC guidelines (as  
262 seen on the ward in BED1 and UTL). Therefore, it is prudent for HCWs and visitors to wear  
263 airborne precautions (eg., an N95 respirator) while residing on these wards, whether in patient  
264 rooms or common areas.

265 During a surge of ill patients, a hierarchy of hospital infection control measures should  
266 be implemented,<sup>23</sup> including engineering controls, administrative controls, and personal  
267 protective equipment (PPE). This approach was used to help curtail the resurgence of TB in the  
268 1990s. While engineering controls are important for the creation of an effective negative-  
269 pressure isolation ward, administrative controls (eg., patient triage and proper ingress and  
270 egress of patients and visitors) and proper donning and doffing of PPE are essential

271 components of infection control and prevention that work in concert. Early in the course of a  
272 high-consequence infectious disease outbreak when large numbers of ill patients require  
273 healthcare services, it may be necessary for hospital engineers to rapidly convert a routinely  
274 functioning ward to a negative-pressure isolation ward. We have demonstrated that this type  
275 of conversion may be achieved in approximately 40 minutes, including installation and  
276 troubleshooting of the anteroom.

277         At our demonstration site, project personnel and hospital staff decided that in addition  
278 to demonstrating the temporary isolation ward, supplemental infection control strategies  
279 would be included. These strategies included a temporary hall anteroom and UV-C lamps in  
280 stairwells. The temporary anteroom showed appropriate pressure and ventilation conditions to  
281 contain airborne contamination, although at times during door-opening events the anteroom-  
282 associated pressure differences were highly variable, probably due to its design and  
283 construction. In six minutes, 99.9% removal efficiency in the temporary anteroom could be  
284 achieved, assuming unobstructed air movement.<sup>2</sup>

285         Anteroom use is often recommended for airborne infection control.<sup>20,24</sup> The optimal  
286 anteroom pressure differentials and flow rates for aerosol containment with consideration of  
287 HCWs moving through doorways have not been determined. Studies have shown that opening  
288 the doors of isolation rooms can generate flow across the doorway.<sup>25-27</sup> Inducing a pressure  
289 difference, however, across a door can decrease the air volume exchange across the door.<sup>25,28</sup>  
290 For this demonstration it would have been optimal to construct an anteroom at each hallway  
291 entrance to the temporary isolation ward (we only constructed one to minimize project  
292 complexity). With two hallway-anterooms, one would be used as a clean anteroom for ingress

293 and PPE donning, and the other would be a potentially contaminated anteroom for egress and  
294 PPE doffing.

295 Upper-room germicidal UV-C fluxes were appropriate for disinfecting any escaping  
296 contamination. Lamps were installed as close to doors as possible to irradiate any air volume  
297 exchange due to door opening. They were accepted by the staff on the ward, which contributed  
298 to the knowledge gained about how surge capacity interventions are viewed by staff.

299 According to the Institute of Medicine's report on medical surge capacity,<sup>5</sup> cost of  
300 pandemic preparedness is important to consider when developing a plan, and tents, temporary  
301 housing materials, disaster response trailers, and HEPA-filtered negative-air machines are  
302 expensive purchases. Temporary patient housing options and gymnasiums also do not typically  
303 provide amenities found in hospital bedrooms such as oxygen supply lines, various medical  
304 devices and equipment, and a bathroom with a toilet and shower. Because of these limitations,  
305 using existing hospital spaces and ventilation systems to establish a surge ward could be an  
306 improvement on previous negative-pressure isolation ward designs. Supplemental methods to  
307 increase surge capacity, such as reverse-triage,<sup>29</sup> reducing non-urgent hospital admissions,<sup>12</sup>  
308 and delaying certain types of surgery,<sup>30</sup> could provide the room availability needed to establish  
309 a surge ward in a functioning hospital.

310 In contradistinction, the key challenges we faced in this project were months of planning  
311 and coordination with hospital administrative processes that are typical for any U.S. healthcare  
312 facility. Close collaboration and cooperation involved numerous departments and disciplines,  
313 including infection control and prevention, nursing and hospice services, occupational health,  
314 environmental agents service, safety services, medical center leadership, and engineering

315 services. The engineering and hospital infection control departments helped design the  
316 temporary ward plan, and input from nursing leadership on the ward was vital for determining  
317 what would be possible during the surge demonstration. Hospital leadership was briefed with  
318 the full plan in the weeks prior to the demonstration. When conducting such a project at a  
319 functioning hospital it is essential to balance the needs of the patients, hospital staff and  
320 requirements for a successful demonstration.

## 321 CONCLUSIONS

322 Our demonstration affirms that a temporary negative pressure isolation ward may be an  
323 effective way to increase surge capacity during a large-scale outbreak of an airborne-  
324 transmissible infectious disease. Even though air pressure differentials well exceeded CDC  
325 guidelines, airflow reversals still occurred. These reversals only occurred within the ward and  
326 not between the hall anteroom and the rest of the hospital, thus still containing a possible  
327 outbreak. Accordingly, it is prudent for healthcare personnel to wear personal protective  
328 equipment when working on temporary negative-negative pressure isolation wards.

## 329 Acknowledgements

330 We sincerely thank the hospital administrators, staff and patients that supported this  
331 project and made it possible. The facility's engineering staff were excellent and helped with all  
332 the ventilation adjustments. We thank the staff who built the anteroom and helped to hang all  
333 the sampling lines within the ward. We appreciate all the students who supported this project  
334 along the way.

335  
336  
337  
338  
339  
340  
341  
342  
343  
344  
345  
346  
347  
348  
349  
350  
351  
352  
353  
354  
355  
356

## References

1. Lurie N, Dausey DJ, Knighton T, Moore M, Zakowski S, Deyton L. Community planning for pandemic influenza: Lessons from the VA health care system. *Disaster Med Public Health Prep* 2008;2(04):251-7.
2. Mead KR, Feng A, Hammond D, Shulman S. Expedient Methods for Surge Airborne Isolation within Healthcare Settings during Response to a Natural or Manmade Epidemic. EPHB Report No. 301-05f. Atlanta, GA [USA]: Department of Health and Human Services, Centers for Disease Control and Prevention, National Institute for Occupational Safety and Health; 2012.
3. Frieden TR, Damon I, Bell BP, Kenyon T, Nichol S. Ebola 2014 – New challenges, new global response and responsibility. *New Engl J Med* 2014;371:1177-1180.
4. IOM. Crisis Standards of Care: Summary of a Workshop Series. Washington, DC [USA]: Institute of Medicine, The National Academies Press; 2010a.
5. IOM. Medical Surge Capacity: Workshop Summary. Washington, DC [USA]: Institute of Medicine, The National Academies Press; 2010b.
6. Hick JL, Barbera JA., Kelen GD. Refining surge capacity: conventional, contingency, and crisis capacity. *Disaster Med Public Health Prep* 2009;3(Suppl 1):S59-S67.
7. US Homeland Security Council. National Strategy for Pandemic Influenza: Implementation Plan. Washington, DC [USA]:US Homeland Security Council; 2006.
8. The Facility Guidelines Institute. Guidelines for Design and Construction of Hospital and Outpatient Facilities, 2014 edition. Chicago IL [USA]: American Society for Healthcare Engineering of the American Hospital Association, p. 422-427; 2009.



- 357 9. ASHRAE. Standard 170-2013. Ventilation for Health Care Facilities. Atlanta, GA  
358 [USA]: American Society of Heating, Refrigerating and Air-Conditioning Engineers,  
359 Inc.; 2013.
- 360 10. GAO. Hospital Preparedness. Most Urban Hospitals Have emergency plans but Lack Certain  
361 Capacities for Bioterrorism Response. GAO-03-924, Report to Congressional Committees.  
362 Washington, DC [USA]: Government Accounting Office. P. 15, Table 2. [www.gao.gov/cgi-](http://www.gao.gov/cgi-bin/getrpt?GAO-03-924)  
363 [bin/getrpt?GAO-03-924](http://www.gao.gov/cgi-bin/getrpt?GAO-03-924); 2003.
- 364 11. Rubinson L, Nuzzo JB, Talmor DS, O’Toole T, Kramer BR, Inglesby TV. Augmentation of  
365 hospital critical care capacity after bioterrorist attacks or epidemics: Recommendations of  
366 the Working Group on Emergency Mass Critical Care. Crit Care Med 2005;33(1):E2393.
- 367 12. Schull MJ, Stukel TA, Vermeulen MJ, Guttman A, Zwarenstein M. Surge capacity associated  
368 with restrictions on nonurgent hospital utilization and expected admissions during an  
369 influenza pandemic: Lessons from the Toronto severe acute respiratory syndrome outbreak.  
370 Acad Emerg Med 2006;13:1228-1231.
- 371 13. Challen K, Bentley A, Bright J, Walter D. Clinical review: Mass casualty triage – Pandemic  
372 influenza and critical care. Crit Care 2007;11(2):212.
- 373 14. Dayton C, Ibrahim J, Augenbraun M, Brooks S, Mody K, Holford D, et al. Integrated plan to  
374 augment surge capacity. Prehosp Disaster Med 2008;23(2):113-119.
- 375 15. Rosenbaum RA, Benyo JS, O’Connor RE, Passarello BA, Williams DR, Humphrey BD, et al. Use  
376 of a portable forced air system to convert existing hospital space into a mass casualty  
377 isolation area. Ann Emerg Med 2004;44:628-634.

- 378 16. Johnson DL, Lynch RA, Mead KR. Containment effectiveness of expedient patient isolation  
379 units. Am J Infect Control 2009;37(2):94-100.
- 380 17. Subhash SS, Radonovich LJ. Hospital surge capacity. ASHRAE J 2011;53(9):76.
- 381 18. NIOSH. Environmental Control for Tuberculosis: Basic Upper-Room Ultraviolet Germicidal  
382 Irradiation Guidelines for Healthcare Settings. DHHS (NIOSH) Publication No. 2009-105.  
383 Atlanta, GA [USA]: Department of Health and Human Services, Centers for Disease Control  
384 and Prevention, National Institute for Occupational Safety and Health; 2009.
- 385 19. ACGIH. Ultraviolet Radiation: TLV® Physical Agents, 7<sup>th</sup> edition Documentation. Cincinnati,  
386 OH [USA]: American Council of Governmental Industrial Hygienists; 2012.
- 387 20. Adams NJ, Johnson DL, Lynch RA. The effect of pressure differential and care provider  
388 movement on airborne infectious isolation room containment effectiveness. Am J Infect  
389 Control 2011;39(2):91-97.
- 390 21. Hyttinen M, Rautio A, Pasanen P, Reponen T, Earnest GS, Streifel A, et al. Airborne infection  
391 isolation rooms – A review of experimental studies. Indoor Built Environ 2011;20:584-594.
- 392 22. Johnson DL, Mead KR, Lynch RA, Hirst DVL. Lifting the lid on toilet plume aerosol: A  
393 literature review with suggestions for future research. Am J Infect Control 2013;41(3):254-  
394 258.
- 395 23. Thorne CD, Khozin S, McDiarmid MA. Using the hierarchy of control technologies to improve  
396 healthcare facility infection control: Lessons from severe acute respiratory syndrome. JOEM  
397 2004;46(7):613-622.
- 398 24. Subhash SS, Baracco G, Fennelly KP, Hodgson M, Radonovich LJ. Isolation anterooms:  
399 Important components of airborne infection control. Am J Infect Control 2013;41:452-455.

- 400 25. Mousavi ES, Grosskopf KR. Airflow patterns due to door motion and pressurization in  
401 hospital isolation rooms. *Sci Technol Built Environ* 2016 May 18;22(4):379-84.
- 402 26. Grosskopf K, Mousavi E. Bioaerosols in health-care environments. *ASHRAE J* 2014;56(8):22.
- 403 27. Tung YC, Hu SC, Tsai TI, Chang IL. An experimental study on ventilation efficiency of isolation  
404 room. *Build Environ* 2009;44(2):271-9.
- 405 28. Kalliomäki P, Saarinen P, Tang JW, Koskela H. Airflow patterns through single hinged and  
406 sliding doors in hospital isolation rooms – Effect of ventilation, flow differential and  
407 passage. *Build Environ* 2016;107:154-68.
- 408 29. Kelen GD, McCarthy ML, Kraus CK, Ding R, Hsu EB, Li G, et al. Creation of surge capacity by  
409 early discharge of hospitalized patients at low risk for untoward events. *Disaster Med Public*  
410 *Health Prep* 2009;3(Suppl. 1):S10-S16.
- 411 30. Soremekun OA, Zane RD, Walls A, Allen MB, Seefeldt KJ, Pallin DJ. Cancellation of scheduled  
412 procedures as a mechanism to generate hospital bed surge capacity – A pilot study. *Prehosp*  
413 *Disaster Med* 2011;26(03):224-9.
- 414

415

## Supplemental Information



416

417


418

419

420

421

**Figure S1.** Pictures of the temporary anteroom installment: (top left) external ingress view, (top right) external egress view, (bottom left) internal ingress view, and (bottom right) internal egress view.

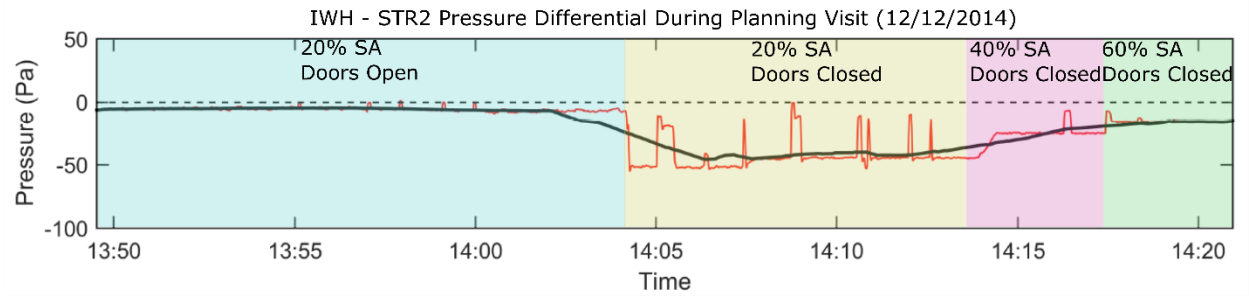

422

423

**Figure S2.** Planning visit stairwell pressure test (SA - supply air).

424

Figure 1  
[Click here to download high resolution image](#)

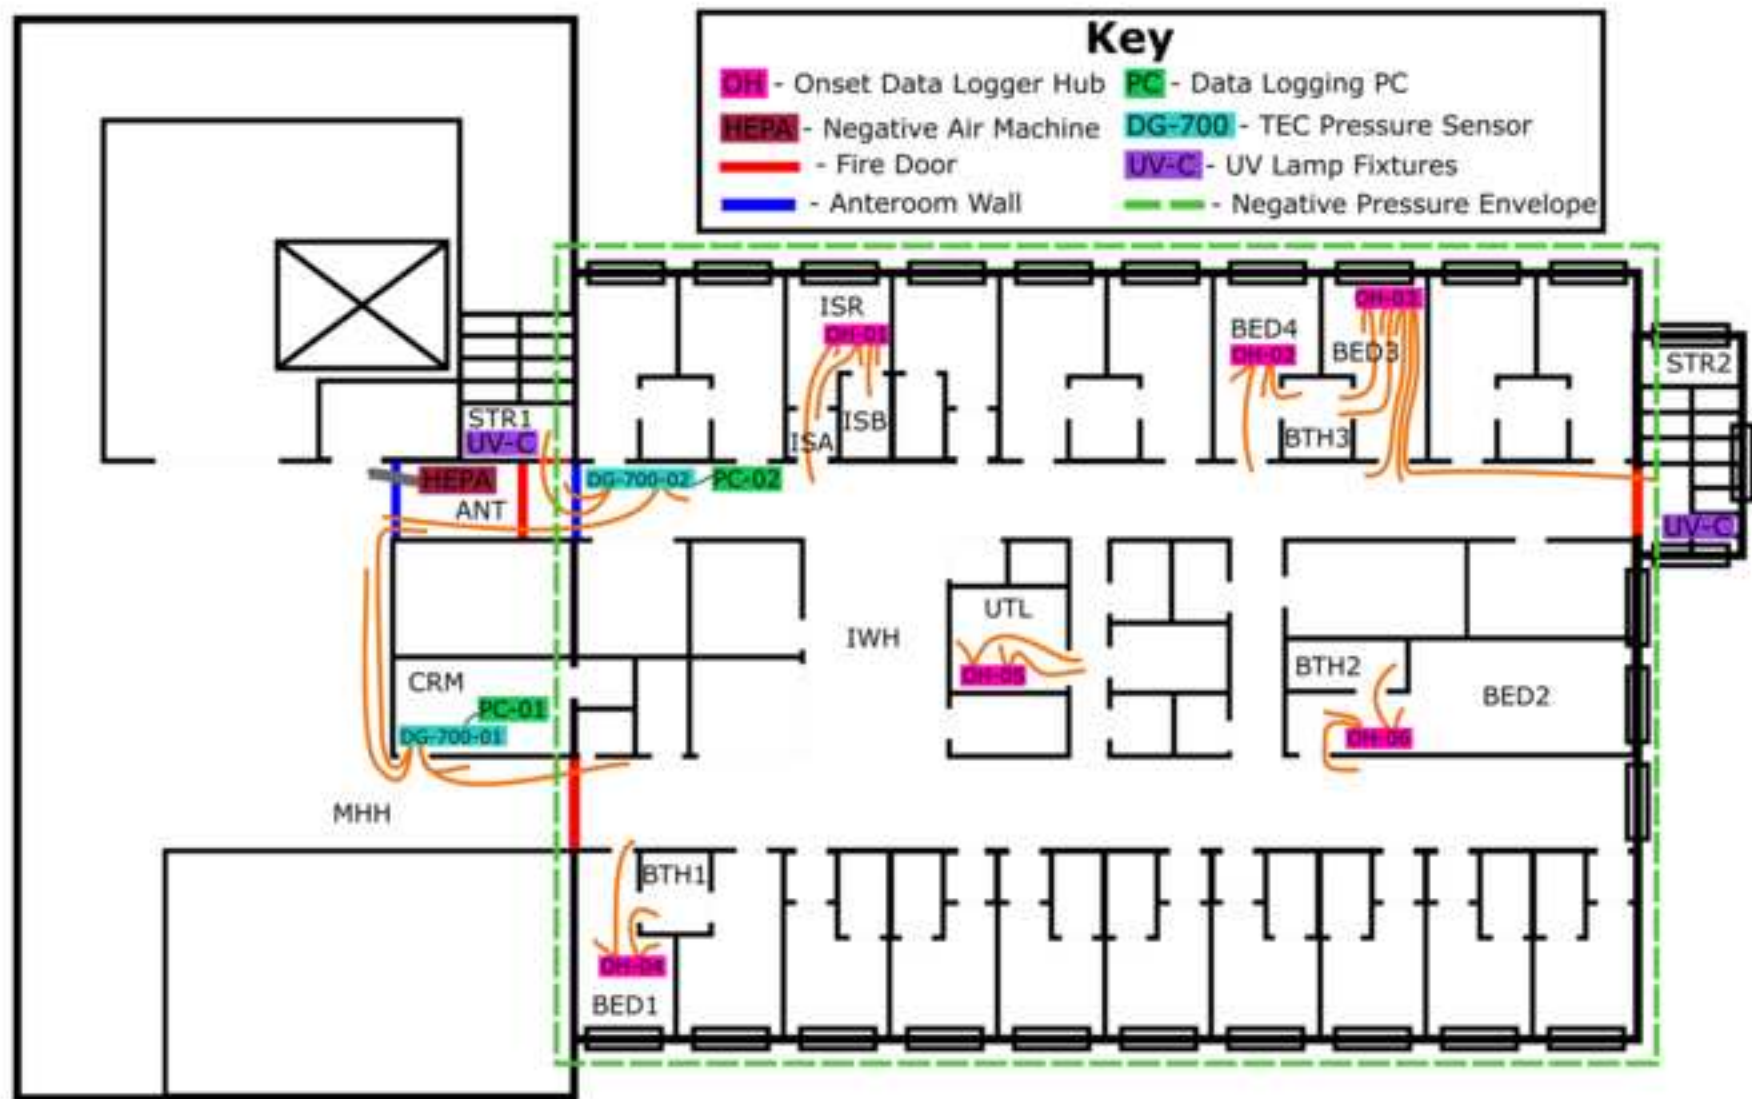
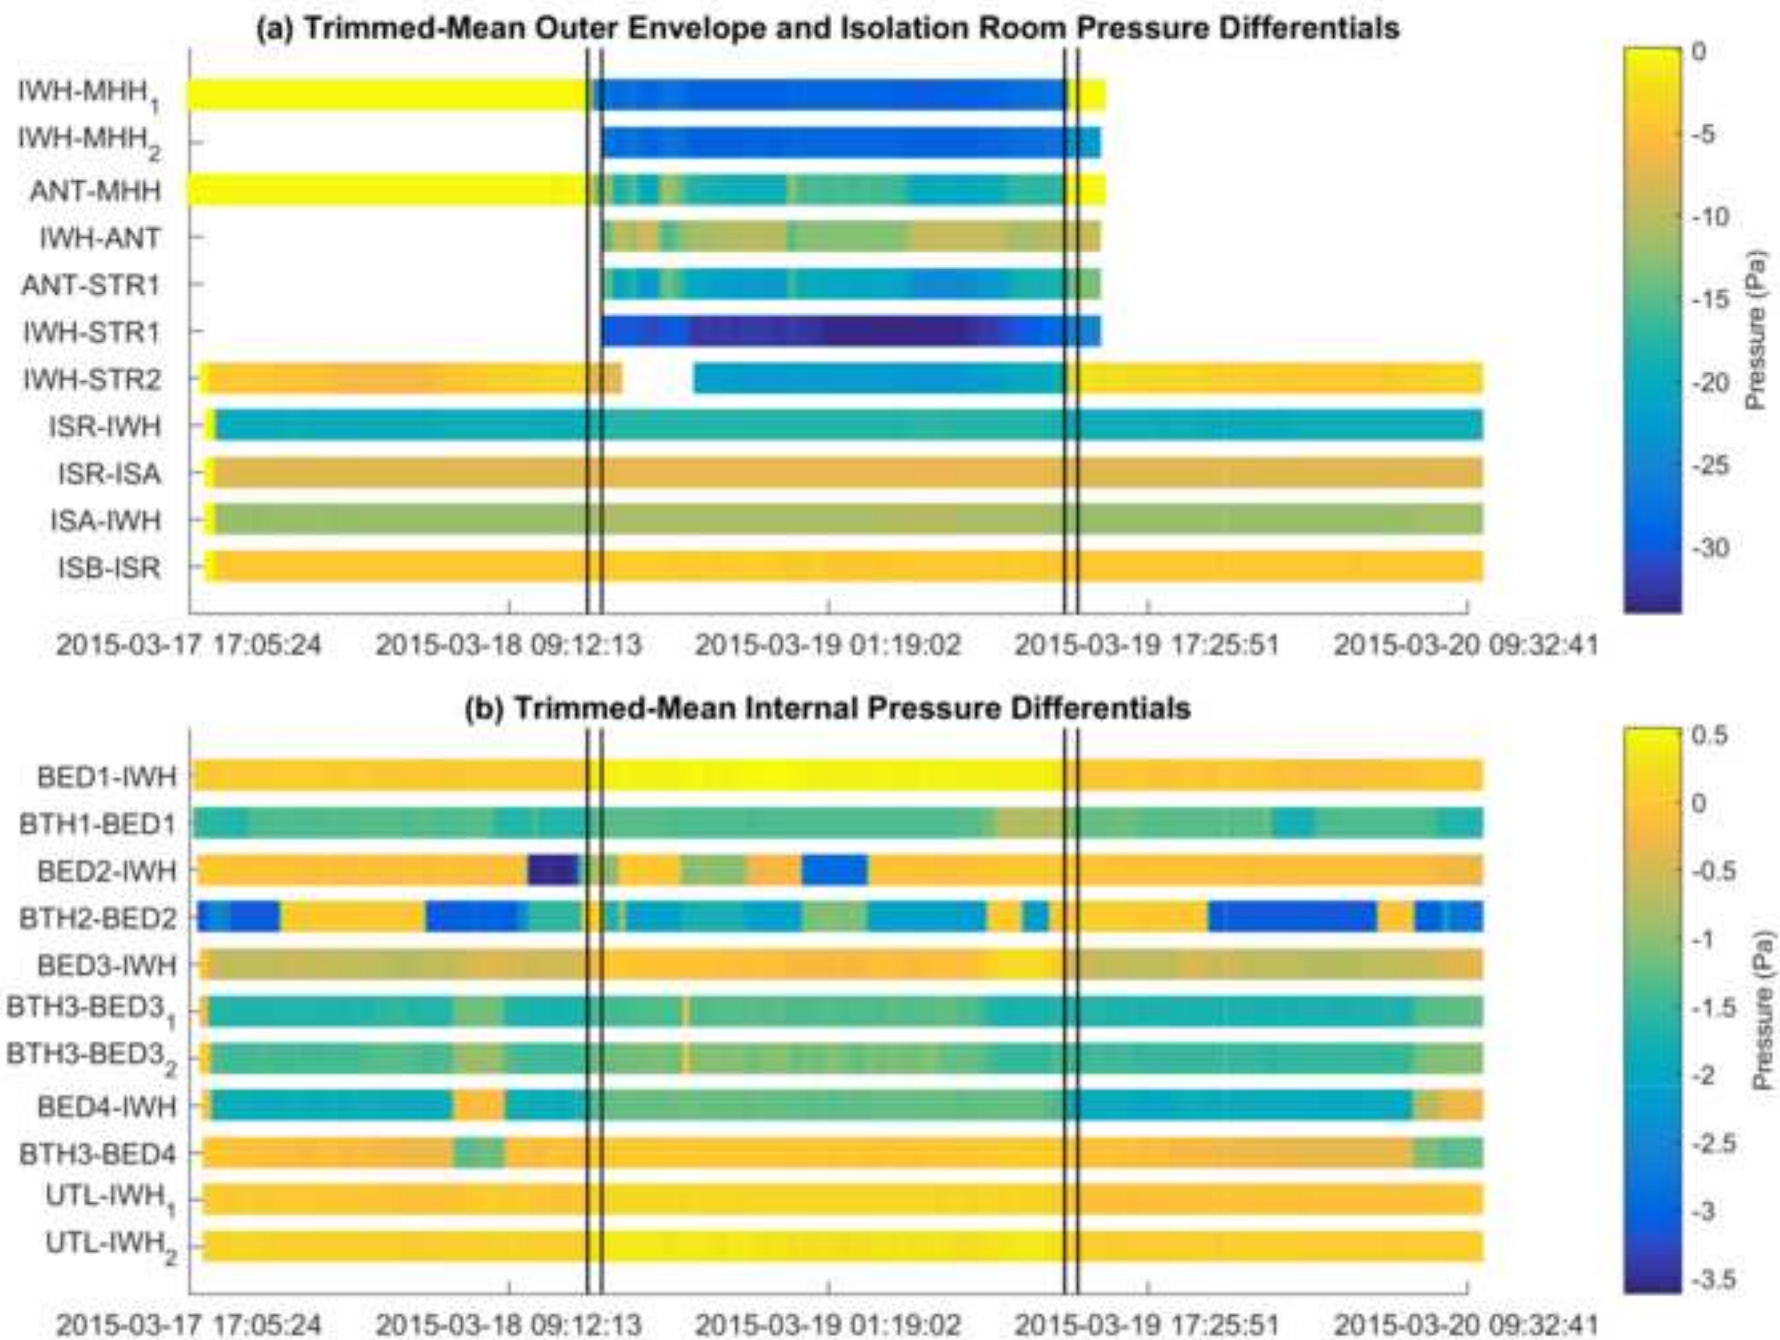




Figure 2

[Click here to download high resolution image](#)



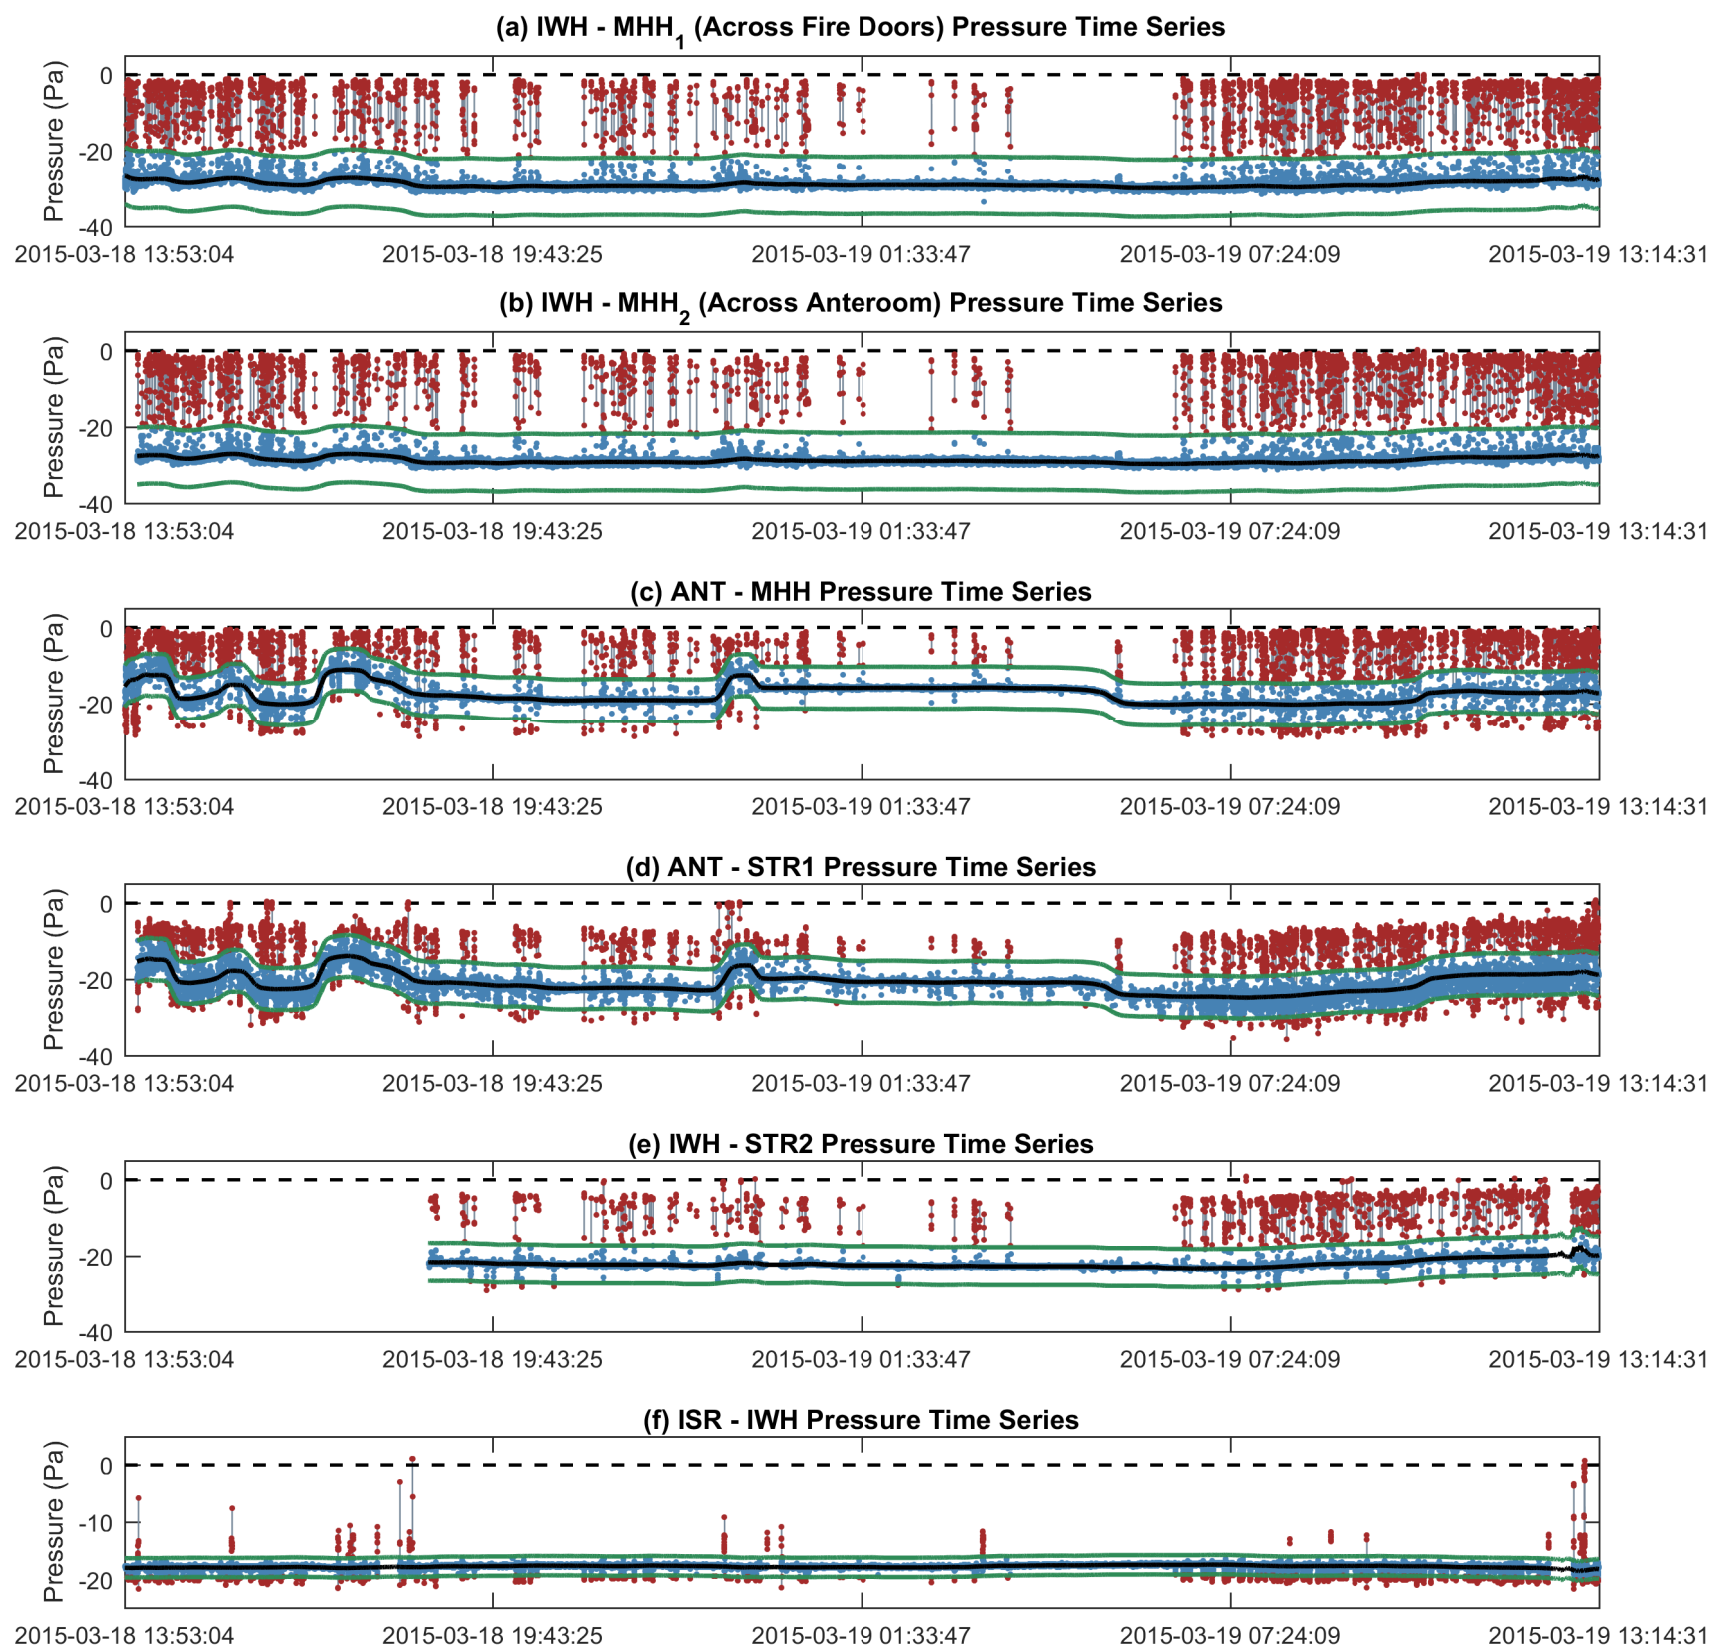
**Figure 3**[Click here to download Figure\(s\): Figure 3.pdf](#)



Figure 4

[Click here to download Figure\(s\): Figure 4.pdf](#)